



JOSEPHINE COUNTY, OREGON

DIVISION 3:
STREET AND TRANSPORTATION SYSTEM
DESIGN STANDARDS MANUAL
Guidelines for Development

Effective: March 1, 2021

Section 1 – General Design Requirements

- 1.1 The purpose of this manual is to set standards for the design and construction of streets, sidewalks, and general transportation system improvements to serve new and future development. This manual may be updated periodically and the design engineer shall ensure that the latest version is being utilized.

Section 2 – Design Plan Format

- 2.1 Engineering plans and specifications shall be prepared for all public works improvements. Plans shall be clear and legible and show all improvements in sufficient detail to allow for determination of compliance with City standards, and proper field construction. City engineer may require additional detail if deemed necessary.
- 2.2 Plan shall show the location, stationing, and geometry of all sidewalks, paved streets, cul-de-sacs, and other transportation infrastructure. The location of existing and new sewer, water, and storm infrastructure components shall also be shown, where applicable. Match lines shall be used when continuing to other sheets.
- 2.3 Profile view with stationing and elevation shall be provided for street improvements. The existing grade and finished grades, at a minimum, will be shown on the profile.
- 2.4 Detail drawings shall be provided for sidewalk ramps, signage, standard road sections, and others as required.
- 2.5 Refer to the City's "Engineering Policy – Guidelines for Development" document for additional requirements and submittal procedures.

Section 3 – Street and Transportation System Design Requirements

- 3.1 Creation of Streets
- 3.1.1 No development may occur unless the development has frontage on or approved access to a public street currently open to traffic. A currently non-opened public right-of-way may be opened by improving it to City Standards.
- 3.1.2 Streets are to be created in a pattern of interconnection to reduce travel distance, provide multiple travel routes, and promote the use of alternative modes.
- 3.1.3 Streets (including alleys) within and adjacent to a development shall be improved to City Standards. In addition any new street or additional street width planned as a portion of an approved street plan shall be dedicated and improved in accordance with this article.
- 3.1.4 Streets are usually created through the approval of a subdivision or partition plat. However, the City Council may also approve the creation of a street by acceptance of a deed.
- 3.1.5 Where necessary to give access to or permit a satisfactory future subdivision of adjoining land, streets shall be extended to the boundary of the subdivision; and the resulting dead-end streets may be approved without a turnaround. Reserve

strips and street plugs may be required to preserve the objectives of street extensions. Typically, the maximum allowable length of a temporary dead-end without a turnaround will be limited to 300-feet, unless otherwise approved by the City Engineer.

3.1.6 Creation of access easements.

- A. In general, the creation of access easements between property owners is discouraged. However, there are some instances where an access easement is the only viable method of providing access to a developable lot. An access easement may be approved when the following criteria are satisfied:
1. No more than two parcels or uses are to be served by the proposed access easement;
 2. There is sufficient room for public right-of-way due to topography, lot configuration, or placement of existing buildings, and,
 3. The City Engineer has determined that there is not a need for a public street with regard to the subject development and location.

3.2 Street Geometry - General

- 3.2.1 The location, width, and grade of streets shall be considered in their relation to existing and planned streets, topographical conditions, and the planned use of the land to be served by the streets.
- 3.2.2 Grades, tangents, curves, and intersection angles shall be appropriate for the traffic to be carried, considering the terrain.
- 3.2.3 As far as practical, streets other than minor streets shall be in alignment with existing streets by continuations of the centerlines thereof. Staggered street alignment resulting in 'T' intersections shall, whenever practical, leave a minimum distance of 200 feet between the centerlines of streets having approximately the same direction, and otherwise shall not be less than 100 feet long.
- 3.2.4 Whenever possible, local streets will be aligned in the same direction as or parallel to the existing streets in the City to maintain the same "grid" layout. A variation of not more than 25 degrees may be allowable upon approval by the City Engineer.
- 3.2.5 Intersections
- A. Streets shall intersect one another at an angle as near to the right angle as is practicable considering topography of the area and previous adjacent layout.
- B. Where not practicable, the right-of-way and street paving within the acute angle shall have a minimum of 30 feet centerline radius where such an angle is not less than 60 degrees.

- C. The intersection of an arterial or collector street with another street shall have at least 100 feet of tangent adjacent to the intersection unless topography requires a lesser distance.
- D. Other streets, except alleys, shall have at least 50 feet of tangent adjacent to the intersection unless topography requires a lesser distance.
- E. Intersections which contain an acute angle of less than 80 degrees or which include an arterial street shall have a minimum corner radius sufficient to allow for a roadway radius of 20 feet and maintain a uniform width between the roadway and the right-of-way line.
- F. On State highways, ODOT standards shall supersede City Standards.

3.2.6 Symmetrical street cross sections are preferred, with opposing curbs at the same grades.

3.2.7 Tilted, warped, super-elevated, or other cross sections are only allowed under specialized cases and as approved by the City Engineer.

3.2.8 All driveways must be located the maximum distance which is practical from a street intersection and in no instance shall the distance from an intersection be closer than the following as measured from the nearest curb return radius:

- A. Arterial Street 40 feet
- B. Collector Street 20 feet
- C. Local Street 10 feet

3.3 Cul-de-sacs

3.3.1 A cul-de-sac shall be as short as possible and no more than 400 feet long or serving more than 18 dwelling units. Wherever possible, a connection to a parallel side street should be used instead of a cul-de-sac.

3.3.2 Each cul-de-sac shall have a circular end with a minimum diameter of right-of-way width for emergency equipment turnaround and paved to the widths discussed later in this section and as shown on the standard detail drawings.

3.3.3 Cul-de-sacs are to be graded so that surface water is shed to the outer curbs and gutters. The finished pavement grade from the center point of the cul-de-sac to the gutter line shall be at least 2-percent (negative).

3.4 Grades and Curves

3.4.1 Grades on streets shall not exceed 6% on arterials, 10% on collector streets, or 12% on any other street.

- 3.4.2 Centerline radii of curves shall not be less than 300 feet on major arterials, 200 feet on collectors, and continuing residential streets, and 100 feet on other streets and alleys and shall be rounded to an even 10 feet.
 - 3.4.3 Where existing conditions, particularly topography, make it otherwise impractical to develop buildable lots, the City may accept steeper grades and sharper curves, but only upon review and approval.
 - 3.4.5 In flat areas, street grades shall have a minimum slope of 0.25 percent with curb and gutter and 0.4 percent with a full depth standard curb.
- 3.5 Alleys
- 3.5.1 Alleys shall be provided in commercial and industrial districts, unless other permanent provisions for access to off-street parking and loading facilities are approved by the City.
 - 3.5.2 Corners of the alley intersection shall have a radius of not less than 12 feet.
 - 3.5.3 The City may require adequate and proper alleys to be dedicated to the public by the land divider of such design and in such location as necessary to provide for the access needs of the subdivision, development, or partitions.
 - 3.5.4 Width of right-of-way and paving design for alleys shall not be less than 20 feet. Slope easements shall be dedicated as required by the City.
 - 3.5.5 Where two alleys intersect, 10 feet corner cut-offs shall be provided.
 - 3.5.6 Grades shall not exceed 21% on alleys and centerline radii on curves shall not be less than 100 feet.
- 3.6 Right-of-Way and Roadway Widths
- 3.6.1 All street width requirements shall be reviewed on a case-by-case basis by the City Engineer.
 - 3.6.2 The width and classification of all streets must conform to any approved transportation master plan or recorded subdivision plat.
 - 3.6.3 Unless otherwise indicated in an approved Master Plan or subdivision plat, the minimum design widths shall be as shown in the following table:

**Table 3.6.3A
Typical Design Widths**

Type of street	Minimum ROW Width (ft)	Minimum Paving Width Curb-to-Curb				Sidewalk Curb (ft)
		Motor Vehicle Travel Lane	Median or Center Turn Lane	On-Street Parking	Bike Lane	
Arterial						
3-lane (a)	90'	2 @ 12'	14'	2 @ 8'	2 @ 5'-6"	2 @ 6'-6"
2-lane	50'	2 @ 12'	-	-	2 @ 5'-6"	2 @ 6'-6"
Commercial (a)	86'	2 @ 12'	14'	2 @ 8'	2 @ 5'-6"	2 @ 6'-6"
Local Residential						
Serving 20 or more Dwelling units (a)	66'	2 @ 10'	-	2 @ 8'	2 @ 5'-6"	2 @ 5'-6"
Serving 20 or less Dwelling units	50'	2 @ 10'	-	2 @ 8'	-	2 @ 5'-6"
Dead End (b)	50'	2 @ 10'	-	2 @ 8'	-	2 @ 5'
Cul de Sac	50'	2 @ 10'	-	(c)	-	1 @ 5' (d)
Alley						
1-way	20'	12'	-	-	-	-

- (a) The minimum right of way width includes the option of two 6 ft. wide landscape strips for three lane arterials or two 4 ft. wide strips for commercial streets or local streets serving 20 or more dwelling units.
- (b) A dead end must be less than 300 feet in length
- (c) No parking is permitted at the end of cul de sac which must have adequate space for emergency equipment turn around, typically a 45 ft. unobstructed radius.
- (d) At the end of the cul-de-sac, a 5 ft. sidewalk is required along the perimeter adjacent to the development.
- (e) A variance is required for right of way widths narrower than the standard.

3.6.4 Standard roadway designs and standard details can generally be used for residential streets and collectors streets. Standard sections are only to be considered minimum designs as actual soil conditions may require thicker base rock or pavement installations.

3.7 Design Capacities and Design Speeds

3.7.1 For the purposes of classifying and defining the design capacities of the various street types, the following table shall be used:

**Table 3.7.1
Typical Design Capacities and Speeds**

Type of Street	Design Capacity, Vehicles per Day	Design Speed, mph
Arterial	32,000	40-50
Collector	10,000	35
Commercial/Industrial other than Arterials	12,000	30
Local Streets serving 20 or More Dwellings	7,000	30
Local Streets serving 20 or less Dwellings	1,200	25
Cul-de-sacs	200	NA

3.8 Curb and Gutter

- 3.8.1 Curb tops shall be set slightly below adjacent ground so as to receive surface drainage.
- 3.8.2 Three-inch diameter weep holes shall be provided through the curbs with inverts one inch above gutter line, at the following locations:
 - A. Opposite existing or anticipated roof downspouts (minimum two per lot).
 - B. At 16 foot on center along low areas where curb top is above adjacent ground.
 - C. At 16 foot on centers adjacent to bank areas to receive ground water.
- 3.8.3 Curb shape to conform to standard details. No “glue-down” extruded curbs shall be allowed in the public right-of-way.
- 3.8.4 Machine extruded curbs, as well as formed and poured curbs, shall require a minimum of 2-inches of $\frac{3}{4}$ ” minus crushed rock base.
- 3.8.5 Maximum allowable tolerance for finished curbs shall be $\frac{1}{2}$ ” on alignment, and $\frac{1}{4}$ ” on grade at any point, providing a “bird bath” does not occur.
- 3.8.6 Provide drop curbs for driveways, curb radii, and ambulatory ramps with original curb pour when locations can be determined in advance.
- 3.8.7 No intruding structures, including, but not limited to, manholes, valves, and junction boxes shall be located within two feet of the curb or gutter, unless otherwise approved by City Engineer.
- 3.8.8 Type ‘C’ concrete curbs may be used on partial street sections or in special circumstances when approved by the City Engineer.
- 3.8.9 Valley gutters are not to be used except for in alleys or other special conditions and only upon approval by the City Engineer.
- 3.8.10 Curb Return Radii
 - A. A WB-67 design vehicle shall be used when designing curb radii for all truck routes. A WB-50 vehicle may be used for some local and residential routes as indicated later in this section.
 - B. Unless otherwise required, or approved by the City Engineer, all other curb radii at public street intersections shall be designed in accordance with Table 3.8.10:

TABLE 3.8.10
Minimum Radii and Design Vehicles for Determining Curb Radii

Primary Street Classification	Secondary Street Classification	Zoning	Minimum Radii (ft)	Design Vehicle
Local	Local	Residential	25	Emergency
Local	Local	Non-Residential	25	Emergency
Collector	Local	Residential	25	Emergency
Collector	Local	Non-Residential	25	WB-50
Collector	Local	Residential	25	Emergency
Collector	Collector	Residential	25	WB-50
Minor Arterial	Collector	All	35	WB-67
Minor Arterial	Minor Arterial	All	35	WB-67

3.9 Driveways

- 3.9.1 Driveways shall conform to the Standard Details.
- 3.9.2 Driveways may be deferred until lots are built upon, if approved by the City Planning Commission or City Council.
- A. If the developer chooses to delay the installation of a driveway approach, additional repair of curb and gutter, sidewalk, and other facilities may be required when the driveway is installed.
- B. The cost of installing a driveway approach and the associated repairs to curb and gutter, sidewalk, and other facilities will be borne, solely, by the developer.
- 3.9.3 Any driveway(s) serving property which is used for purposes other than single family residential or duplexes shall be designed as and built to the standards of a commercial driveway.
- 3.9.4 A concrete alley apron serving public right-of-way or alley shall be built to the standards of a commercial driveway.
- 3.9.5 Residential Driveway Approach Standards
- A. A residential driveway approach shall be constructed of Portland cement concrete, minimum of 6-inches in thickness, 3,000 psi field strength, with 2-inches (minimum) compacted $\frac{3}{4}$ "-0" crushed rock base. No rebar or wire mesh is required for residential approaches.
- B. Transition flares shall also be constructed to the same standard as residential driveway approaches.

3.9.6 Commercial Driveway Approach Standards

- A. A commercial driveway approach shall be constructed of Portland cement concrete, minimum 8-inches in thickness, 3,500 psi field strength, with 2-inches (min) compacted $\frac{3}{4}$ "-0" crushed rock base, and placed with No. 4 rebar on 12-inch centers both ways at 2-inches above the bottom of the slab, or place 2 layers of 6x6x10 welded wire mesh at 2-inches above the bottom of the slab.
- B. Transition flares shall be constructed to the same standards for commercial driveway approaches.

3.9.7 No driveway approach slope shall exceed 15-percent.

3.10 Access Ramps

- 3.10.1 All pedestrian ramps shall conform to the current Americans with Disabilities Act (ADA) federal regulations and to the current Oregon Department of Transportation requirements.
- 3.10.2 Where applicable, ramp approaches shall be aligned with and be wholly contained within, the crosswalk markings.
- 3.10.3 Ramp approaches shall not be positioned directly in the path of catch basin grates.
- 3.10.4 Ramp approaches shall be directly aligned with one another with no offset through the intersection.
- 3.10.5 Ramp approaches shall be as close as possible to perpendicular to the street they are crossing in order to minimize the crossing distance.
- 3.10.6 Ramps shall be aligned to point directly to the ramp across the road that is intended to receive the pedestrian.
- 3.10.7 Obstructions including, but not limited to, mail boxes, water meters, valves, junction boxes, manholes, utility poles, trees, benches, fire hydrants, signs, and bus stops shall not be located within the ramp area or the flares.
- 3.10.8 Ramp flares may extend beyond the crosswalk markings.
- 3.10.9 Two ramps shall be provided at each curb radius to allow direct access from the ramps into the street.
- 3.10.10 At local residential street "T" intersections, driveway approaches designed and constructed to ADA standards may be used to provide pedestrian access provided they are constructed with no lip at the gutter bar.

3.11 Sidewalks

- 3.11.1 All development for which land use applications are required must include sidewalks adjacent to public streets. This requirement also applies to new single-family houses and duplexes if they are located on arterial or collector streets or on curbed local streets if there is an existing sidewalk within 500 feet on the same side of the street.
- 3.11.2 In the case of arterial or collector streets, sidewalks shall be built during their construction and considered during their reconstruction or rehabilitation. This provision shall apply also to local streets that serve commercial and multi-family development.
- 3.11.3 The provision of sidewalks may be waived where the street serves a use or combination of uses which generate fewer than fifty trips a day (based on ITE standards) and cannot be continued or extended to other properties. A waiver shall only be granted upon review and approval of the City Engineer.
- 3.11.4 Sidewalks are required on both sides of all streets.
- 3.11.5 Design, Width, and Location
- A. The required width for a sidewalk on an arterial or commercial street is six (6) feet. This width may be reduced to (5) feet if the sidewalk is separated from the curb by a landscaped planter strip at least six (6) feet in width for a three lane arterial street and four (4) feet for a commercial street for those instances when there is inadequate right-of-way.
 - B. In all cases, the right-of-way remaining outside of the sidewalk is to be landscaped and maintained by the adjoining property owner.
 - C. Sidewalks along residential and other local streets must be a minimum of five (5) feet in width. Sidewalk design may be setback or integral as determined by the developer, City Engineer, or funding agency.
 - D. If a setback sidewalk design is selected, a planter strip at least six (6) feet wide shall separate the sidewalk from the street (curb). If trees are to be planted in the planter strip, they must be of an approved variety.
 - D. Regardless of other provisions in this standard, any sidewalk project less than 200 feet in length and connects on either end to an existing sidewalk may be designed to match the existing pattern with the approval of the City Engineer. Generally, sidewalks shall be consistent with the existing sidewalk design in the same block. Transitions should be made at intersections whenever possible.
 - E. Where obstructions existing or are proposed (including, but not limited to mail boxes, utility poles, trees, planters, fire hydrants, signs, benches, bus stops, etc.), provisions must be made to maintain a minimum of four feet of unobstructed sidewalk width on local streets, and five feet on collector and arterial streets.

- F. Maintenance of sidewalks and planter strips shall be the continuing obligation of the adjacent property owner except where the lot backs onto an arterial street.
- G. Sidewalks shall be designed to parallel streets in line and grade and shall avoid unnecessary meandering from the curb line and elevation changes except as necessary to avoid significant trees or traverse topographic barriers.
- H. All sidewalks are to be a minimum of four (4) inches thick Portland cement concrete placed on a minimum of two (2) inches compacted ¾"-0" crushed rock base.

3.12 Bikeways

- 3.12.1 Where bikeways are required or planned, bikeways should be separated from other modes of travel, including pedestrian.
- 3.12.2 Minimum widths for bikeways shall be five (5) feet where adjacent to a curb (one-way) and ten feet when not on the roadway (2-way).

3.13 Utilities

- 3.13.1 Except for sanitary and storm sewers all utilities shall be located outside of the paved area if at all possible to avoid future street cuts.
- 3.13.2 On all phased (interim) street improvements, the necessary utilities shall be stubbed across the interim improvements to insure that cuts are not necessary when the road is expanded to its full width.
- 3.13.3 Except for sanitary sewer, storm sewer, and water, underground utilities intended to provide direct service to adjacent properties with future connections shall not be located in the full-width paved section of a street to be constructed. If all service connections are existing and extend beyond the full-width section of a partially improved (or interim) street, underground utilities can be located in the future paved section of the street, if approved by the City Engineer.
- 3.13.4 Underground utilities being constructed along newly paved streets shall not be located under the existing pavement unless approved by the City Engineer.
- 3.13.5 Underground utilities that must cross an existing paved street shall not be installed by any method which cuts the pavement or undermines the aggregate base of the street unless approved by the City Engineer.
- 3.13.6 All underground utilities shall be installed at a minimum bury depth of thirty (30) inches as measured from the finished grade to the top of utility.
- 3.13.7 When new curbing is being placed, (in conjunction with new utility mains or service laterals), a stamp shall be placed in the top of the curb to mark the located where each water and/or sewer service crosses the curb. The method of marking

the curb shall be approved by the City Engineer and noted on the approved construction plans. An imprinting stamp is preferred that is capable of leaving an impression directly into the curing concrete. A "W" shall be used for a water service and an "S" shall be used to designate a sewer service. The stamped impressions should be a minimum of two (2) inches in height, placed on the top of the curb.

3.14 Pavement Markings

3.14.1 All pavement traffic markings for lane stripping, railroad crossings, crossings and stop bars shall be thermoplastic and shall conform to the Manual of Uniform Traffic Control Devices, (MUTCD) regulations alternative markings will not be allowed without prior approval from the City Engineer or representative.

3.15 Street Lighting

3.15.1 All new developments and subdivisions are required to provide street lighting systems. Complete wiring diagrams, including spacing of luminaries or the street lighting system must be submitted to the City at the time of plane review, if the system is to be dedicated to the City.

3.15.2 The system will only be transferred to the City after the City has completed its final inspection and the system has been signed off by the City Engineer and after installation is complete.

3.16 Trenching and Street Cuts

3.14.1 The City will not allow, without prior approval from the City Engineer, any street cuts on newly paved or resurfaced streets (paved within the past 12 months).

3.14.2 All approved street cuts in streets of higher functional classification than local residential shall be backfilled with Controlled Density Fill (CDF or CLSM as specified in OSS Section 00442) meeting the material requirements of the supplier. However, the City Engineer may require CDF on residential local streets if conditions warrant.

Section 4 – Construction Provisions

- 4.1 All work within the public right-of-way shall be conducted by a licensed and bonded contractor. This requirement shall be stated on the construction drawings and specifications.
- 4.2 City shall be notified at least 3 working days in advance prior to commencing construction work.
- 4.3 Traffic control shall be signed, flagged and conducted in a manner conforming to ODOT standards (Manual of Uniform Traffic Control Devices, MUTCD) and approved by Benton County, where appropriate. If road closures or detours are anticipated, prior approval from City, ODOT, and County officials must be obtained, as appropriate.

- 4.4 Safety Requirements. The contractor is responsible for observing the safety of the work and all persons and property coming into contact with the work. The contractor shall conduct his work in a manner complying with the requirements prescribed by OSHA.
- 4.5 Progress. Construction shall proceed in a systematic manner to minimize public inconvenience and disruption of services. All excavations, embankments, stockpiles, waste areas, etc. shall be kept protected. All roads, ditches, etc. shall be kept free from debris and shall be continually cleaned during the work. Dust control measures shall be employed as required and directed by the City.
- 4.6 Protection of Existing Improvements. Contractor shall contact the Utility Notification Center (1-Call) at least 48 hours in advance of digging operations to get approximate locations for buried utilities. Exact locations of buried facilities may not be known or shown and contractor is responsible to pot-hole carefully in advance of the work to avoid such facilities. Contractor shall coordinate with all utilities and notify them immediately in the event of any damage. Contractor shall protect, repair, and replace any damaged utilities as directed by the persons responsible for such utility. All landscape, grass, shrubs, signs, pavements, mail boxes, driveways, culverts, gravel surfacing, fencing, etc. shall be protected from damage and returned to conditions as good, or better than existed prior to construction. All costs for protection, repair, and replacement of all existing items shall be borne entirely by the contractor. Contractor shall obtain a release from any property owners for any claims of injury or property damage prior to final acceptance of the work by the City.
- 4.7 All existing survey monuments and control shall be protected, including individual property corner stakes. Any such monuments destroyed or altered during construction shall be restored by the contractor or developer in accordance with ORS.
- 4.8 Any temporary disruption to water or sewer service must be coordinated with, and approved by the City and kept to the minimum length of time necessary. The City shall be notified at least 2 working days in advance of when an approved shut-down is desired. Contractor shall not operate any valves or hydrants without City approval.
- 4.9 Compaction testing equipment (nuclear gauge) shall be furnished and operated by the contractor or an independent testing firm shall be retained by the contractor or developer to perform compaction testing. Testing shall conform to the ODOT Manual of Field Testing Procedures (MFTP). Compaction testing shall be conducted in the presence of the City's inspector. Sufficient tests will be taken to ensure that the materials and compaction efforts being used are adequate to obtain the required density. Several tests shall be taken on each lift placed during the first day of backfill operations. Additional tests will be taken periodically during the work. Alternate materials or methods will be required if adequate compaction is not being obtained.
- 4.10 Construction staking will be provided by the Developer's Engineer for establishing the alignment and grade of the transportation system to be constructed. Offset stakes shall be placed at no more than 100-foot intervals along the alignment. Grade staking, stationing, and other field layout shall be as required.

Section 5 – Street and Transportation System Materials

- 5.1 All materials shall be newly manufactured. No rebuilt, reconditioned or used material will be allowed.
- 5.2 Oregon Standard Specifications (OSS) – Means the current Oregon Standard Specifications for Construction produced by ODOT and APWA, including latest revisions. In general, all paving materials, workmanship, and technical data shall conform to the OSS if not specified otherwise.
- 5.3 Portland Cement Concrete Pavement
- 5.3.1 Concrete shall conform to OSS Section 00440, Commercial Grade Concrete. Compressive field strength shall not be less than 3,500 psi at 28 days.
- 5.3.2 Maximum aggregate size shall be 1½-inches.
- 5.3.3 Slump shall be between 2 and 4 inches and shall not exceed 5 inches.
- 5.3.4 Prior to constructing a roadway or street using Portland cement concrete, the mix design for the concrete shall be provided to the City Engineer for review and acceptance. Included in the mix design will be a description of the proportions for the ingredients of the mix, including:
- A. Air entraining admixtures.
 - B. Chemical admixtures.
 - C. Each size of aggregate.
 - D. Fly ash.
 - E. Other admixtures
 - F. Water
- 5.3.5 Concrete used for public street construction will, generally, meet the requirements of Oregon Standard Specifications for Construction (ODOT-OSS), 2002 Edition, Section 2001.
- 5.4 Asphalt Concrete Pavement
- 5.4.1 Asphalt concrete pavement used for public street improvement projects shall meet or exceed the requirements of OSS Edition 2002, Section 00744.
- 5.4.2 AC pavement on all projects within the City shall be Level 2 HMA mixtures with qualities typical of what has traditionally be designated a Class B asphalt concrete mix.
- 5.4.3 In the case of an overlay or if patching materials are required, a finer asphalt mix (commonly referred to as Class C) may be utilized.

5.4.4 For areas of higher traffic volume, heavy traffic (weight) ratings, or other special traffic loading, a specific pavement design will be required to be submitted to the engineer for review and approval.

5.5 Base Rock and Surfacing Rock

5.5.1 Base rock used to construct a foundation for AC pavement construction shall be 1"-0 crushed rock or crushed gravel conforming to the requirements of OSS Edition 2002, Section 00640.

5.5.1 Base rock used for gravel surfacing, shoulders, and other surfacing shall be 1"-0 crushed rock or crushed gravel conforming to the requirements of OSS Edition 2002, Section 00640.

5.6 Overlay Fabric

5.6.1 An engineering geotextile fabric shall be utilized for all overlays. The fabric shall be needle-punched, non-woven polypropylene fabric, fused on one side only and having the following minimum physical properties:

Weight, oz/sq. yd.	3.8
Tensile strength (per ASTM D-1682)	90
Elongation at break, %	55
Asphalt retention, gal/sq yd	0.25
Min. melting temp, °F,	350

5.7 Asphalt Tack Coat

5.7.1 Tack coat shall meet the requirements of OSS, 2002, Section 00730.

5.7.2 Acceptable tack products include CSS-1, CSS-1h, CMS-2, CMS-2S, CMS-2h, CRS-1, CRS-2, HFRS-2, or HFMS-2.

5.7.3 The Contractor shall provide a submittal to the City Engineer, for approval, of the type of tack material to be utilized on the project.

5.8 Pavement Markings

5.8.1 Thermoplastic pavement markings shall be Type B (preformed fused thermoplastic film) as specified in Section 00850 of the latest addition of ODOT Standard Specifications for highway Construction.

5.9 Street Lighting

5.9.1 All new luminaries shall be Holophane Refractopack or RSL-200 Series lighting. Decorative lighting and other systems may be acceptable if submitted to and approved by the City. A 5-year warranty and replacement period will be required by the City for lighting systems used other than that as specified above.

- 5.9.2 Poles for new street lighting systems shall be galvanized metal poles mounted on concrete bases. Other poles such as spun aluminum and fiberglass may be acceptable if submitted and prior approval is given by the City.
- 5.9.3 Heights of new luminaries shall be 25 feet for residential and collector streets and 30 feet for arterial and commercial streets.
- 5.9.4 All wiring for the street lighting systems shall be located within the street right of way or easement and shall be placed underground in conduit.
- 5.9.5 Luminaries Sizing

Residential Streets	100 watt HPS
Collector Streets	200 watt HPS
Arterial Street	400 watt HPS

Section 6 – Street and Transportation System Installation (Workmanship)

- 6.1 All excavation, grading/fill within the city limits of Cave Junction shall comply with the City’s Standards, the Oregon Structural Specialty Code Appendix J and DEQ Erosion Control Standards.
 - 6.1.1 When Grading/Fill Permits may be Required
 - A. An excavation that is more than two (2) feet in depth or creates a cut slope greater than five (5) feet in height and steeper than one (1) unit vertical in one in one half (1 ½) units horizontal.
 - B. A fill of more than one (1) foot in depth and placed on natural terrain with a slope greater than one (1) unit vertical in five (5) units horizontal.
 - C. A fill greater than three (3) foot in depth.
 - D. A fill intended to support structures.
 - E. A fill that exceeds fifty (50) cubic yards on any lot.
 - F. Placement of fill obstructs a natural drainage course.
 - G. Grading in an area that may create danger to private or public properties.
 - H. Grading/Fill permits are required if changes to the existing topology and landscaping are completed prior to the review and issuance of building permits.
 - 6.1.2 Required Elements of Grading
 - A. Grading of less than 5,000 cubic yards and do not have any special conditions or hazards, as determined by the City Engineer or representative shall be considered “regular grading”.
 - B. Grading in excess of 5,000 cubic yards shall be performed in accordance with the approved grading plans shall be designated as “engineered grading” and shall be prepared by a Professional Engineer (PE) licensed in the State of Oregon.
 - C. Professional inspection and testing may be required by a soils engineer when it is determined that geological factors may be involved, the grading/fill will conform to the requirements of the geotechnical report and engineered plans.

- D. Each application for a development permit shall be accompanied by a grading / fill plan of sufficient clarity to indicate the nature and extent of the proposed work.
- 6.1.3 A Heavy Haul permit may be required when excavated material is being transferred offsite to another disposal site.
- 6.2 Clearing and Grubbing
 - 6.2.1 Clear improvement area of all surface vegetation, stumps, roots, downed timber, brush, weeds, grasses, and deleterious matter necessary to accommodate permanent construction.
 - 6.2.2 Protect existing utilities, street surfaces, landscaping, adjacent private development, and survey monuments from damage unless approved by the City Engineer. Any damage to existing infrastructure shall be repaired immediately.
 - 6.2.3 Dispose of clearing and grubbing waste off project site at a location approved by the City Engineer. Clearing debris cannot be utilized as fill on the project site.
 - 6.2.4 Grub areas under new street sections, curbs, sidewalks and driveways to remove all stumps, roots, buried vegetation, and debris to a depth of at least 8-inches below subgrade. Larger debris that may affect the integrity of the finished road should be removed regardless of depth or as directed by the City Engineer.
- 6.3 Earthwork and Embankment
 - 6.3.1 Excavate to subgrade lines and grades as required by the approved plans.
 - 6.3.2 Advise and coordinate earthwork with utility companies prior to beginning excavation to confirm utility locations and depths and potential conflicts or minimum cover issues. Required relocation of utilities shall be identified during design.
 - 6.3.3 Protect existing utilities from damage during excavations. Any utilities damaged during excavation not designated for removal shall be replaced "in kind" at the developer's expense.
 - 6.3.4 Where excavation is required, along edges of pavement or trenches, any raveled or deteriorated pavement edges shall be saw cut clean and straight.
 - 6.3.5 Over-excavate to remove soft or otherwise unsuitable subgrade material when directed by City Engineer. Backfill with imported base rock or approved native backfill at 95 percent of maximum density (AASHTO T99) as directed by the Engineer. City Engineer may require that a geotextile fabric be utilized to provide additional subgrade stabilization.
 - 6.3.6 In street embankment areas, all sod, vegetative matter, and debris to be stripped away from under subgrade before embankment is placed.

- 6.3.7 Where rock excavation is required, efforts shall be made to remove rock without blasting whenever possible. If blasting is determined to be required, a blasting plan must be submitted to the City Engineer, for approval. The blasting plan must include a certificate of insurance for the blasting work, the amount of and type of explosives that are to be used, the methods for placement and ignition, planned safety precautions, and all other pertinent information. Blasting shall not commence until the City Engineer has provided written clearance for the use of explosives within the City Limits.
 - 6.3.8 Approved excavated materials may be used directly in street embankment and site fill grading areas where provided for on the approved plans. Unsuitable material including broken pavement, rubble, large rocks, and debris shall be disposed of offsite by Contractor as approved by the City Engineer.
 - 6.3.9 Topsoil should be selectively excavated and segregated to be used for curb backfill and planting strip area surfacing.
 - 6.3.10 Shape and grade all cut and fill slopes. Final slopes shall be smooth, uniform, and compacted in conformance to lines and grades required by plans.
 - 6.3.11 Rough grade subgrade prior to utility crossings to 0.20 foot vertical and 0.50 foot horizontal tolerance to design cross section and grades.
 - 6.3.12 After utility crossings and curb installations, fine grade subgrade to within 0.10 feet vertically of design grade at any point.
 - 6.3.13 All embankment material to be placed in compacted lifts, not to exceed 6-inches in thickness.
 - 6.3.14 Condition fill material with water to attain optimum moisture content prior to placing in embankment. Additional sprinkling of subgrade may be required to achieve compaction and for dust control.
 - 6.3.15 All subgrade, embankment, and backfill of over-excavation lifts shall be compacted to 95-percent of maximum density per AASHTO T-99 test method. City engineer shall approve the condition of subgrade and shall certify testing results prior to placing rock or base materials.
 - 6.3.16 Place top soil backfill behind curbs and dress back disturbed planting strip area, smooth and uniform to the property lines. Compact until firm as evidenced by insignificant deflection under wheel or track loads.
- 6.4 Concrete Curb and Gutter
- 6.4.1 Top of curb stakes to be set at intervals not to exceed 50 feet and at critical radii and grade points, on offset line as required by the Contractor.
 - 6.4.2 Form and poured curbs can be set on compacted subgrade or base rock. Machine laid curbs are required to have a minimum 2-inch lift of compacted base rock.

- 6.4.3 Concrete curb and gutters shall conform to the dimensions shown on the standard detail drawings.
 - 6.4.4 Construct drop curbs for driveways and bike paths where required or as directed by the City Engineer.
 - 6.4.5 Install curb weep-holes where required and in conformance with the standard details.
 - 6.4.6 Construction tolerance for curb and gutter is $\frac{1}{2}$ " online and $\frac{1}{4}$ " on grade.
 - 6.4.7 Include $\frac{1}{2}$ " curb expansion joints at intervals not to exceed 45 feet, at radius points, and at all abutting concrete construction. Cold cutting curb joints on 10' intervals may be allowed in lieu of the above.
 - 6.4.8 Construct $\frac{1}{8}$ " minimum weakened plane contraction joints at intervals not to exceed 15 feet.
 - 6.4.9 Contractor shall notify City Engineer for form or grade inspection prior to pouring and allow 48 hours notice for inspection. Any curb or gutter found to be deficient by the City Engineer shall be removed and replaced at the Contractor's expense.
- 6.5 Sidewalks and Driveways
- 6.5.1 Expansion and contraction joints shall conform to the requirements of the OSS, 2002.
 - 6.5.2 Sidewalk edges shall be tooled with a $\frac{1}{4}$ " radius tool.
 - 6.5.3 A broom or burlap finish shall be applied in a workmanlike manner. An effort shall be made to match adjacent finishes of existing sidewalk if the finish meets the requirements of OSS, 2002.
 - 6.5.4 Sidewalks shall be sloped $\frac{1}{4}$ " per foot up and away from curb to facilitate water draining over the top of the curb.
 - 6.5.5 Sidewalks and driveways shall be laid on prepared subgrade, compacted to 95 percent of maximum density per AASHTO T-99 test method or on compacted $\frac{3}{4}$ "-0 rock fill.
 - 6.5.6 Rock base shall be placed and compacted to refill curb excavation where sidewalks are to be constructed adjacent to curbs.
 - 6.5.7 Sidewalks shall be constructed to within $\frac{1}{2}$ " on-line and $\frac{1}{4}$ " on grade tolerance for smooth, uniform alignment and grade.
 - 6.5.8 Driveways and sidewalks across driveways shall have a minimum concrete thickness of 6-inches. Normal sidewalks shall have a minimum thickness of 4-inches.

- 6.5.9 Install 3" diameter roof drain pipe under sidewalks where required in alignment with curb weep holes.
- 6.5.10 Restore top soil and dress back disturbed surfaces within planting strip in manner approved by the City Engineer.
- 6.6 Base Rock and Surfacing Rock
 - 6.6.1 Rocking shall not be performed prior to City Engineer approval of the subgrade conditions.
 - 6.6.2 Compact base rock to 95 percent of relative maximum density per AASHTO T-99.
 - 6.6.3 The maximum compacted thickness of each lift of base rock shall be 6-inches.
 - 6.6.4 Surfacing rock (shoulders, gravel streets, etc) shall be placed in a single lift with a minimum thickness of 2-inches compacted thickness.
 - 6.6.5 Soft or spongy subgrade shall be removed, and the excavation backfilled with approved subgrade materials or base rock compacted to 95-percent of maximum density per AASHTO T-99.
 - 6.6.6 Water shall be applied as necessary to facilitate compaction and aid in dust control.
- 6.7 AC Pavement
 - 6.7.1 Paving should only commence after City Engineer approved rock surface and compaction, the weather conditions are appropriate, and all other preparations have been made. Any AC pavement that is placed in less than ideal conditions or without City Engineer approval may not be accepted.
 - 6.7.2 Cut edges of existing pavement clean and straight and apply a tack coat where new pavement will join existing. When necessary, apply a thin layer of blow sand on tack joints to prevent them from being damaged or removed by vehicular traffic. Ragged, uneven, or wandering edges at the intersection of new and existing pavement will not be accepted.
 - 6.7.3 Apply a tack coat to manhole frames, valve boxes, catch basins, curbs, gutters, other pavements, or any other component that the new pavement should remain in contact with.
 - 6.7.4 Adjust all rims of manholes, catch basins, valve boxes, etc. to conform to finished pavement grade. No such structure shall be paved over.
 - 6.7.5 Finish pavement lines and grades shall conform accurately with lines and grades shown on plans and staked in field. Tolerance on grade is 3/8 inch on 16' straightedge at any point.

- 6.7.6 Finished pavement thickness shall be as specified on the approved plans. Minimum thickness of pavement shall be 4 inches (2 – 2” compacted lifts). Thinner sections may be approved by City engineer on a case by case basis.
 - 6.7.7 Blend pavement to meet catch basin inlets, existing pavements, valve boxes, manholes, and similar structures.
 - 6.7.8 Traffic should be kept off fresh pavement until it has adequately cooled and set up.
 - 6.7.9 Maintain barricades, warning signs, and flaggers for safety during construction.
- 6.8 AC Pavement Overlays
- 6.8.1 When an AC overlay is required, the surface of the existing road shall be cleaned of all loose debris, gravel, vegetation, or other.
 - 6.8.2 Cracks greater than 1/8” in width are to be filled with a bituminous sealing product meeting the requirements of ASTM D3405 and AASHTOM301 and as approved by the City Engineer.
 - 6.8.3 Patch existing AC pavement areas as required by and identified by the City Engineer. Excavation shall be required where identified or directed by the City Engineer. New base material and AC pavement to be placed in the repair areas per Section 6.6 of this specification.
 - 6.8.4 A tack coat shall be applied to assist the overlay to adhere to the existing surface. The application rate of the tack coat shall be, at a minimum, 0.25 gallons per square yard throughout the overlay area. Application of tack coat will be made by distributor equipment wherever possible, with hand spraying kept to a minimum.
 - 6.8.5 The temperature of the tack material shall be such to facilitate a uniform spray pattern as recommended by the manufacturer. Spray nozzles shall be kept clear and open to avoid “holidays” in the pattern.
 - 6.8.6 The width of the tack spray pattern shall be the width of the paving fabric role plus 6 inches on each side. Overspray, drools, or spills shall be removed from the road surface to avoid flushing, bleeding, or fabric movements.
 - 6.8.7 Adequate tack shall be applied to the road to saturate the fabric to form a membrane but shall not be excessive to cause a slippage plane or flushing of the overlay.
 - 6.8.8 The fabric is to be placed in the tack coating with a minimum of wrinkles prior to the sealant cooling. The fabric should be unrolled with the bearded or fuzzier side down. Excessive wrinkles should be cut and laid flat. The City Engineer shall observe the placement of the tack and fabric and approve the installation prior to the overlay placement.

-
- 6.8.9 Overlays of the fabric shall be minimized though an overlap of 6 to 8 inches is appropriate to insure full closure of a pavement joint. Transverse joints should be “shingled” in the direction of traffic to prevent edge pickup. Additional sealant may be required to secure these edges as necessary.
 - 6.8.10 Placement of the AC overlay should closely follow fabric lay-down. In the event that the tack coat bleeds through the fabric before the hot mix is placed, it may be necessary to blot the sealant by spreading sand or hot mix over the affected areas.
 - 6.8.11 AC Pavement should be machine laid and compacted per OSS, 2002 and Section 6.6 of this specification.
 - 6.8.12 Feather all AC pavement onto existing pavement not receiving overlay. Rake out coarse aggregate on payment feather. Surface of pavement shall be a smooth, well-sealed, tight mat.
- 6.9 Pavement Markings
- 6.9.1 Pavement markings shall be applied prior to allowance of public traffic on the freshly paved surfaces, unless prior approval from City Engineer.
 - 6.9.2 Pavement surface shall be free of dirt, grease, moisture or any other foreign material prior to placement of striping and pavement markings.
 - 6.9.3 Pavement markings shall be applied in accordance with manufactures recommendations. The ambient temperature shall be at least 10-C and rising.
- 6.10 Street Lighting
- 6.10.1 Luminaries shall be spaced at least 250 feet apart but at no time greater than 500 feet apart. Street lighting shall be placed within the street right of way at property lines whenever possible.
 - 6.10.2 Luminaries shall be installed following manufactures recommendations and guidelines.

STREET AND TRANSPORTATION SYSTEMS

STANDARD DETAIL DRAWINGS INDEX

- T-050: STANDARD PAVED STREET
- T-051: TYPICAL ROADWAY LAYOUT
- T-052: TYPICAL ROADWAY LAYOUT
- T-053: TYPICAL CUL-DE-SAC DETAIL
- T-054: STANDARD UTILITY LOCATIONS
- T-150: RESIDENTIAL DRIVEWAY APPROACH DETAIL
- T-151: COMMERCIAL DRIVEWAY APPROACH DETAIL
- T-201: PEDESTRIAN/BIKE PATH DETAIL
- T-210: STANDARD SIDEWALK DETAILS
- T-211: SIDEWALK AND RAMP DETAIL WITH PLANTER STRIP
- T-212: SIDEWALK AND RAMP DETAIL WITHOUT PLANTER STRIP
- T-213: RAMP AND TEXTURE DETAIL WITH PLANTER STRIP
- T-214: RAMP AND TEXTURE DETAIL WITHOUT PLANTER STRIP
- T-301: CURB AND GUTTER DETAIL
- T-302: VALLEY GUTTER DETAIL
- T-401: STANDARD STREET LIGHT DETAIL
- T-450: STANDARD SIGN DETAIL
- T-451: STREET SIGN AND LETTERING DETAILS
- T-501: STANDARD PERMANENT BARRICADE DETAIL



City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

STANDARD DETAIL DRAWING INDEX

DETAIL NO.

T-010


03/01/2021



City of Cave Junction
 222 W. Lister Street
 Josephine, Oregon 97523
 (541) 592-2156

STANDARD PAVED STREET

DETAIL NO.
T-050
 03/01/2021

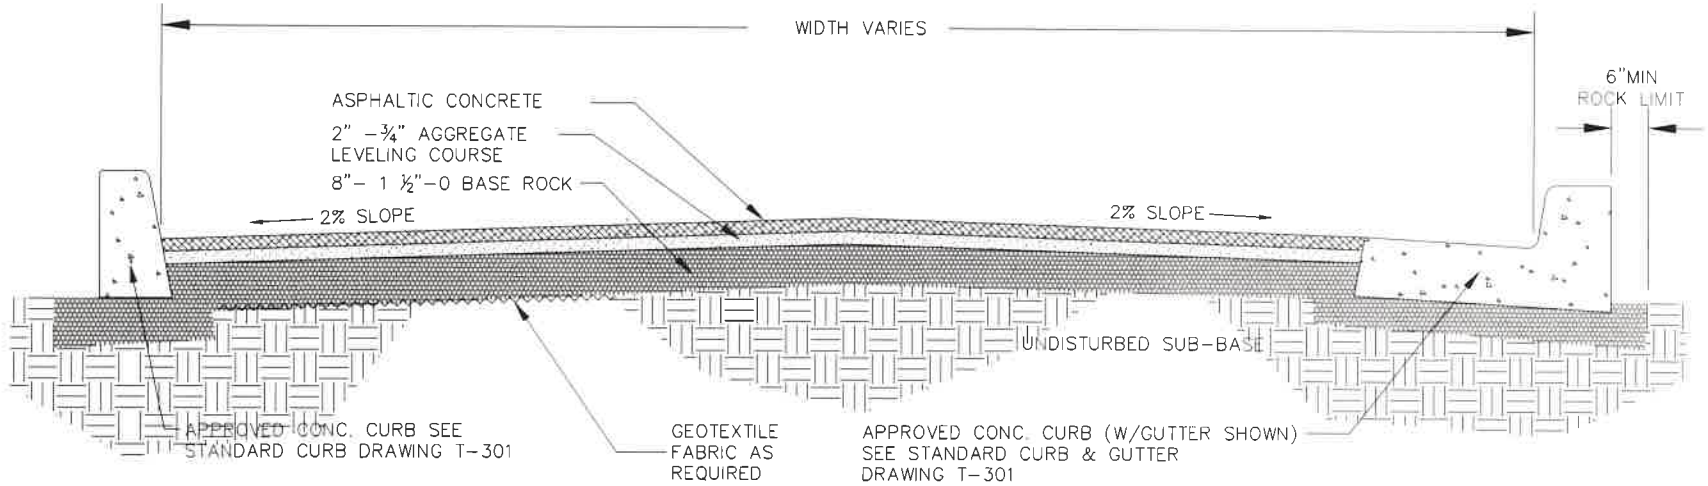


NOTES:

- 1) REFERENCE CITY OF ADAIR VILLAGE DEVELOPMENT STANDARDS FOR MATERIALS
- 2) STREETS SHALL BE PAVED AND CENTERED IN THE PUBLIC RIGHT OF WAY
- 3) DEVELOPER SHALL OBTAIN WRITTEN APPROVAL TO PAVE OVER ANY PUBLIC UTILITIES LOCATED WITHIN RIGHT OF WAYS, AS REQUIRED.
- 4) THE DEVELOPER SHALL OBTAIN A RIGHT OF WAY USE PERMIT AND SUBMIT A COMPLETE SET OF ENGINEERED DRAWINGS SHOWING THE PLAN AND PROFILE VIEWS OF EXISTING CONDITIONS AND PROPOSED WORK. WHEN PROJECT IS COMPLETE, THE DEVELOPER SHALL FURNISH THE CITY WITH A COMPLETE SET OF REPRODUCIBLE DRAWINGS AND CD SHOWING THE "AS CONSTRUCTED" CONDITIONS OF THE COMPLETED PROJECT.
- 5) SEE DESIGN STANDARDS MANUAL FOR COMPACTION OF MATERIALS AND TESTING.
- 6) ASPHALT CONCRETE PAVEMENTS PLACED WITHIN ARTERIAL & COMMERCIAL ROADWAYS SHALL BE PLACED TO A THICKNESS OF 4 INCHES (SET IN 2-2 INCH LIFTS) ASPHALT CONCRETE PAVEMENTS PLACED WITHIN LOCAL STREETS AND ALLEYS SHALL BE PLACED TO A THICKNESS OF 2 INCHES (SET IN A SINGLE LIFT) ALL UNLESS OTHERWISE SPECIFIED.


3 LANE ARTERIAL
STANDARD CURB & GUTTER WITH SIDEWALKS
90' right-of-way

W/O LANDSCAPE STRIP

W/LANDSCAPE STRIP

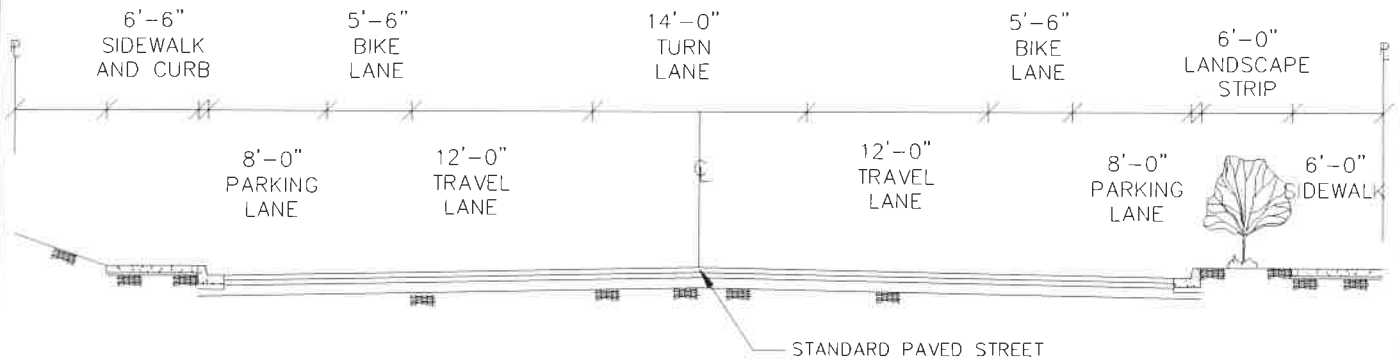


2 LANE ARTERIAL
STANDARD CURB & GUTTER WITH SIDEWALKS
50' right-of-way

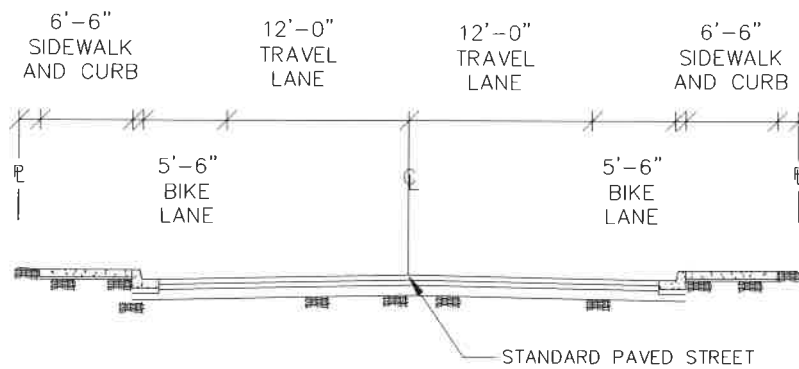

COMMERCIAL ROADWAY
STANDARD CURB & GUTTER WITH SIDEWALKS
86' right-of-way

W/O LANDSCAPE STRIP

W/LANDSCAPE STRIP

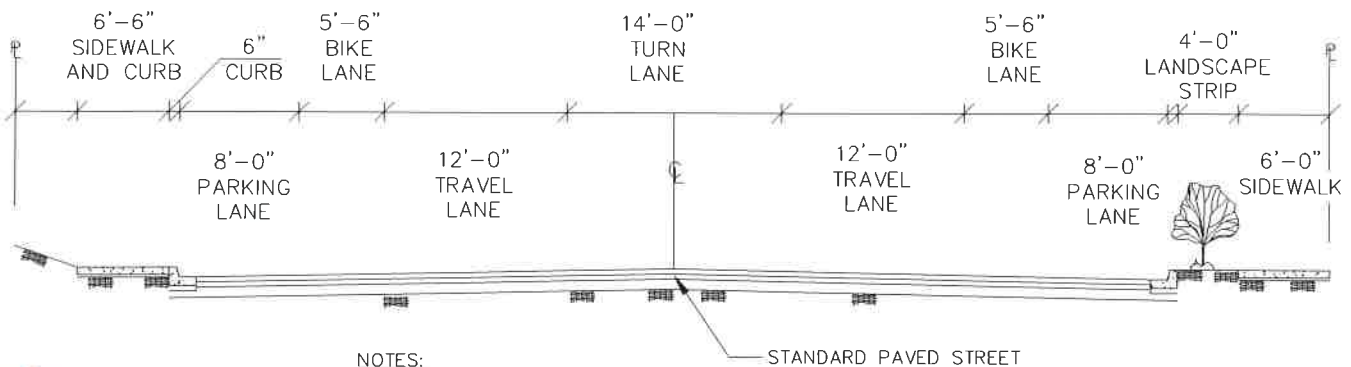

NOTES:

1. APPROVED SIDEWALKS SEE STANDARD SIDEWALK DETAIL T-210

2. APPROVED CONCRETE CURB & GUTTER SEE STANDARD CURB & GUTTER DETAIL T-301

3. ALTERNATE STREET LAYOUT SYSTEMS MAY BE ACCEPTABLE IF SUBMITTED TO AND APPROVED BY THE CITY.



City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

TYPICAL
ROADWAY LAYOUTS

DETAIL NO.


T-051

03/01/2021


LOCAL STREET
 STANDARD CURB & GUTTER WITH SIDEWALKS
 Serving more than 20 dwelling units
 66' right-of-way

W/O LANDSCAPE STRIP

W/LANDSCAPE STRIP

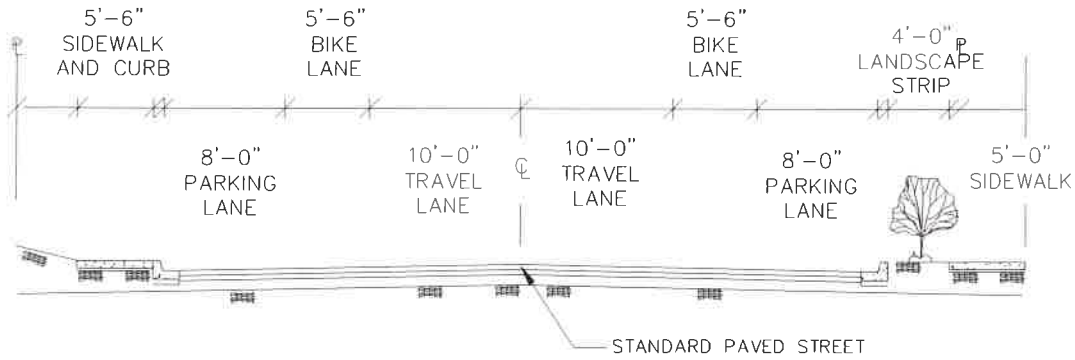


LOCAL STREET
 STANDARD CURB & GUTTER WITH SIDEWALKS
 Serving less than 20 dwelling units and Dead End Street
 50' right-of-way

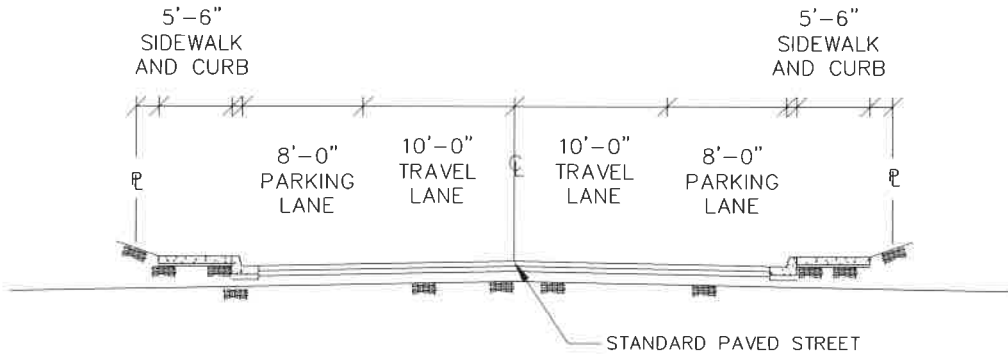

NOTES:

1. APPROVED SIDEWALKS SEE STANDARD SIDEWALK DETAIL T-210
2. APPROVED CONCRETE CURB & GUTTER SEE STANDARD CURB & GUTTER DETAIL T-301
3. ALTERNATE STREET LAYOUT SYSTEMS MAY BE ACCEPTABLE IF SUBMITTED TO AND APPROVED BY THE CITY.

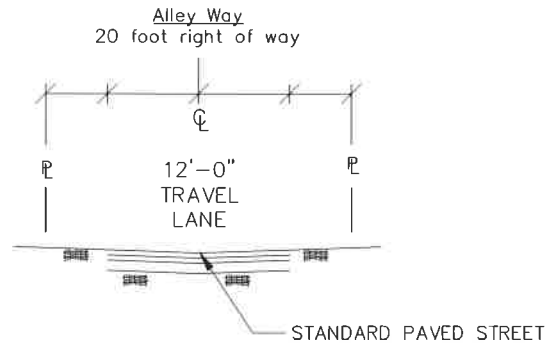


City of Cave Junction
 222 W. Lister Street
 Josephine, Oregon 97523
 (541) 592-2156

**TYPICAL
 ROADWAY LAYOUTS**

DETAIL NO.

T-052

03/01/2021

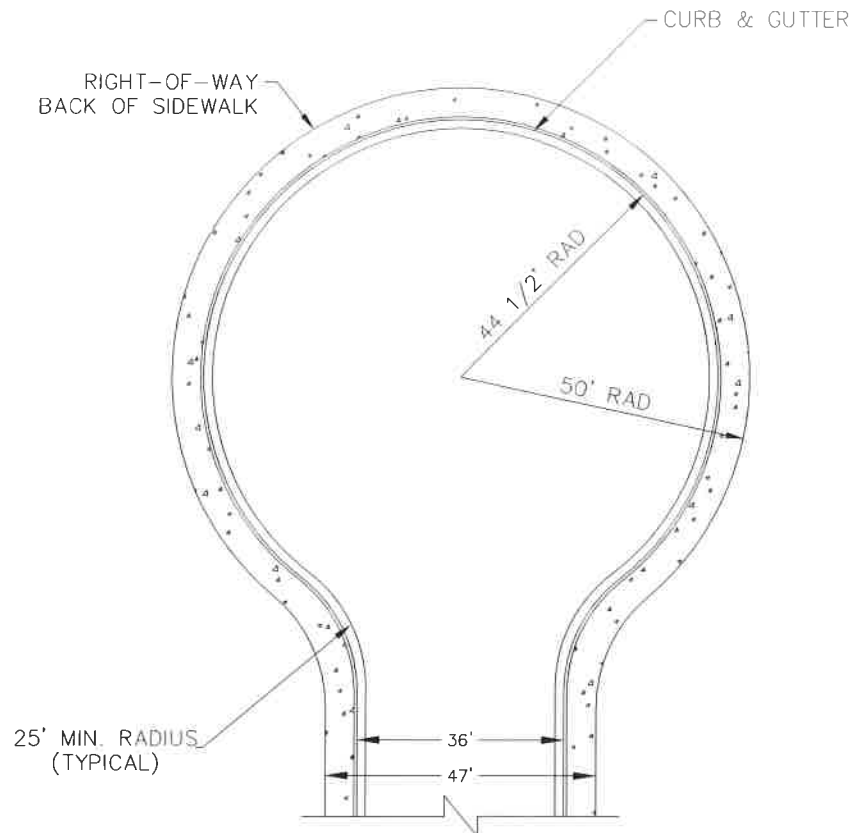

NOTES:

1. MOUNTABLE CURBS ALLOWED IN CUL-DE-SAC UPON PRIOR APPROVAL.
2. CUL-DE-SAC GEOMETRY SHOWN DOES NOT ALLOW FOR ON-STREET PARKING. IF ON-STREET PARKING IS DESIRED, THE RADIUS TO THE FACE OF CURB MUST BE INCREASED TO ACCOUNT FOR A SINGLE PARKING LANE WIDTH. (MINIMUM 8 FEET)





City of Cave Junction
 222 W. Lister Street
 Josephine, Oregon 97523
 (541) 592-2156

TYPICAL CUL-DE-SAC DETAIL

DETAIL NO.

T-053

03/01/2021

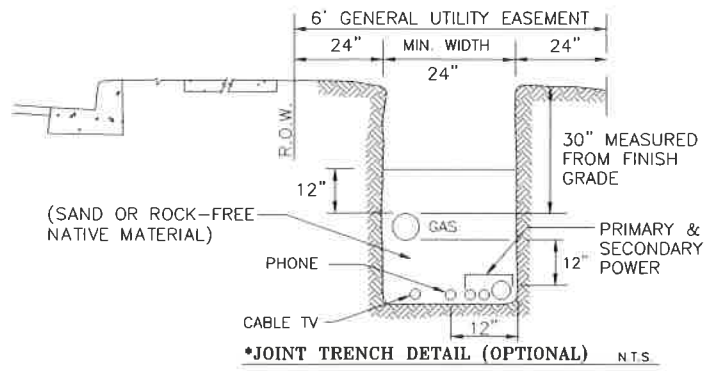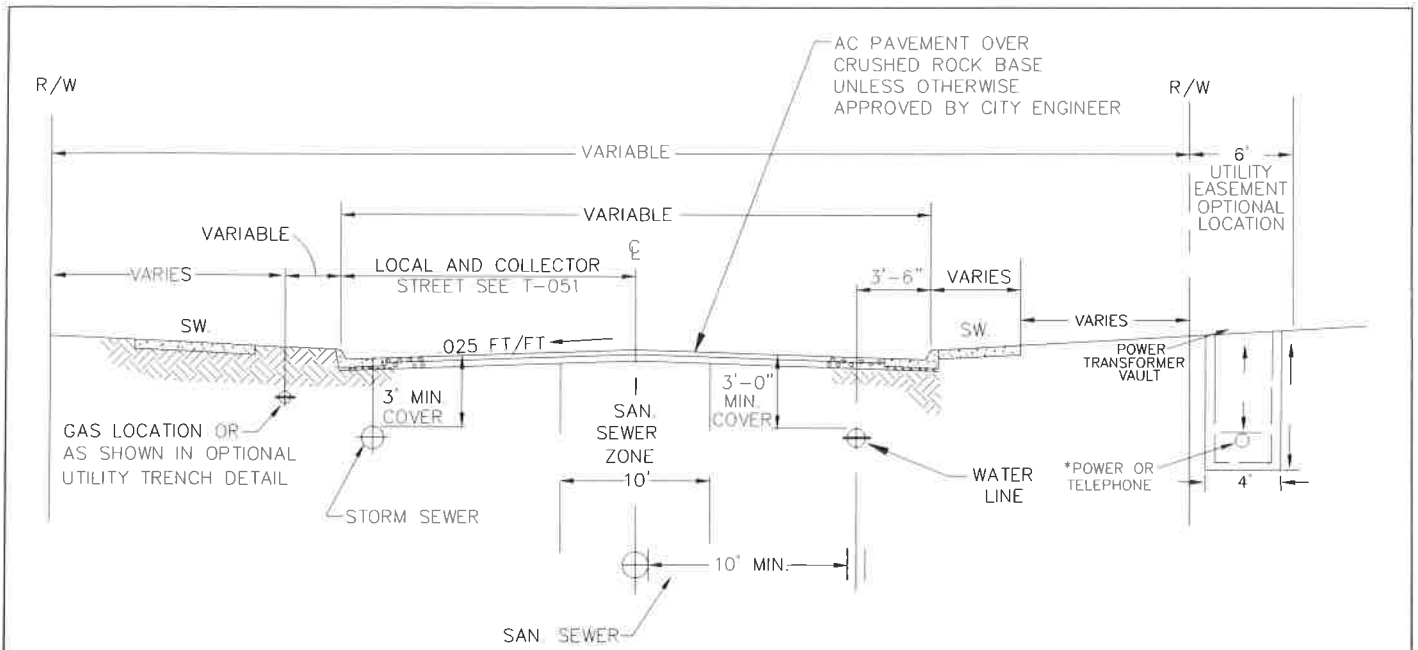

NOTES:

1. WATER MAIN TO BE LOCATED 3'-6" INSIDE FROM FACE OF CURB OR AS OTHERWISE DIRECTED.
2. 10' HORIZONTAL SEPARATION BETWEEN WATER AND SEWER WHERE POSSIBLE. COMPLY WITH SEPARATION REQUIREMENTS OF OAR 333-061-050.
3. WATER DISTRIBUTION MAINS SHALL HAVE 36" MINIMUM COVER OR AS OTHERWISE DIRECTED.
4. SEWER MAINS SHALL HAVE 5.25' (63") MINIMUM COVER UNLESS OTHERWISE APPROVED TO AVOID CONFLICTS WITH WATER AND OTHER UTILITIES.
5. WATER MAINS TO BE LOCATED ON NORTH OR EAST SIDE OF STREET WHEN PRACTICAL.
6. WATER, SEWER, STREETS AND DRAINAGE SYSTEMS ARE SUBJECT TO CITY STANDARDS.
7. MANHOLE LIDS SHALL NOT BE LOCATED DIRECTLY IN NORMAL WHEEL PATH.
8. ALL LAYOUTS AND LOCATIONS ARE SUBJECT TO CITY APPROVAL.




City of Cave Junction
 222 W. Lister Street
 Josephine, Oregon 97523
 (541) 592-2156


STANDARD UTILITY LOCATIONS

DETAIL NO.
T-054
03/01/2021

SIDEWALK ADJACENT TO CURB
NOT TO SCALE

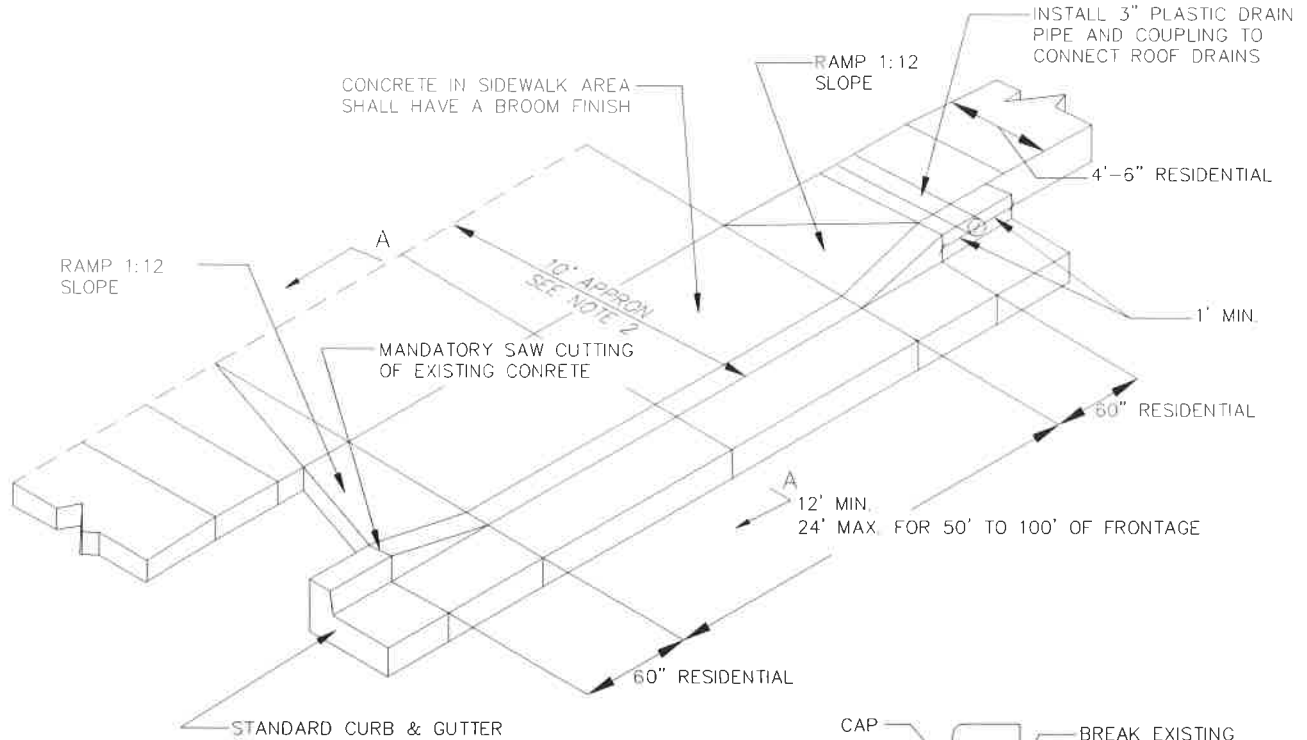


SIDEWALK AWAY FROM CURB
NOT TO SCALE

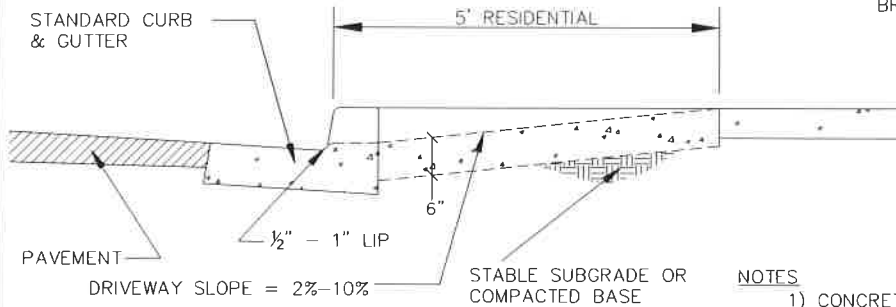

SECTION A-A
NOT TO SCALE

NOTES

- 1) CONCRETE SHALL HAVE A MINIMUM BREAKING STRENGTH OF 3500 PSI AFTER 28 DAYS, FOR ALL DRIVEWAY APRONS (6") AND DRIVEWAY EXTENTIONS (4")
- 2) 10' CONCRETE APRON REQUIRED FOR ALL DRIVEWAYS WHERE NO SIDEWALK IS CONSTRUCTED.
- 3) 4" THICKNESS OF CONCRETE FROM BACK OF SIDEWALK OR DRIVEWAY APRON TO PROPERTY LINE WHERE PRIVATE DRIVE IS CONCRETE
- 4) DRIVEWAY MUST MEET EXISTING STREET GRADE
- 5) CITY APPROVAL REQUIRED FOR DEVIATION FROM WIDTH STANDARDS
- 6) PERMITS AND INSPECTIONS ARE REQUIRED ON NEW AND EXISTING STRUCTURES THE INSPECTION WILL BE MADE AFTER THE FORMS HAVE BEEN SET
- 7) FOR SIDEWALKS REFER TO STANDARD SIDEWALK DETAIL T-210
- 8) FOR CURB & GUTTER REFER TO STANDARD CURB & GUTTER DETAIL T-301

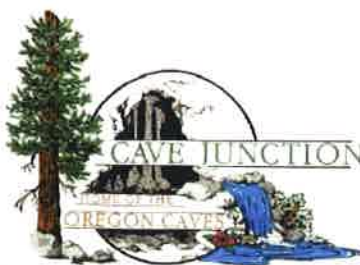


City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

**RESIDENTIAL DRIVEWAY
APPROACH DETAIL**


DETAIL NO.
T-150
03/01/2021

PLAN

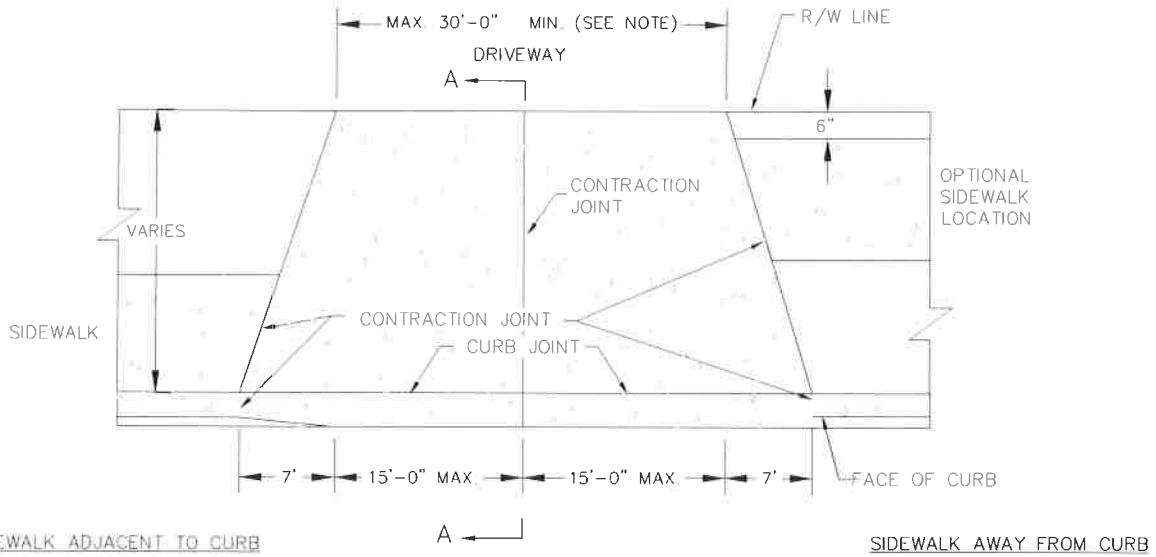

NOTE: ONE-WAY TRAFFIC - MIN. 15' DRIVEWAY
TWO-WAY TRAFFIC - MIN. 24' DRIVEWAY

ELEVATION

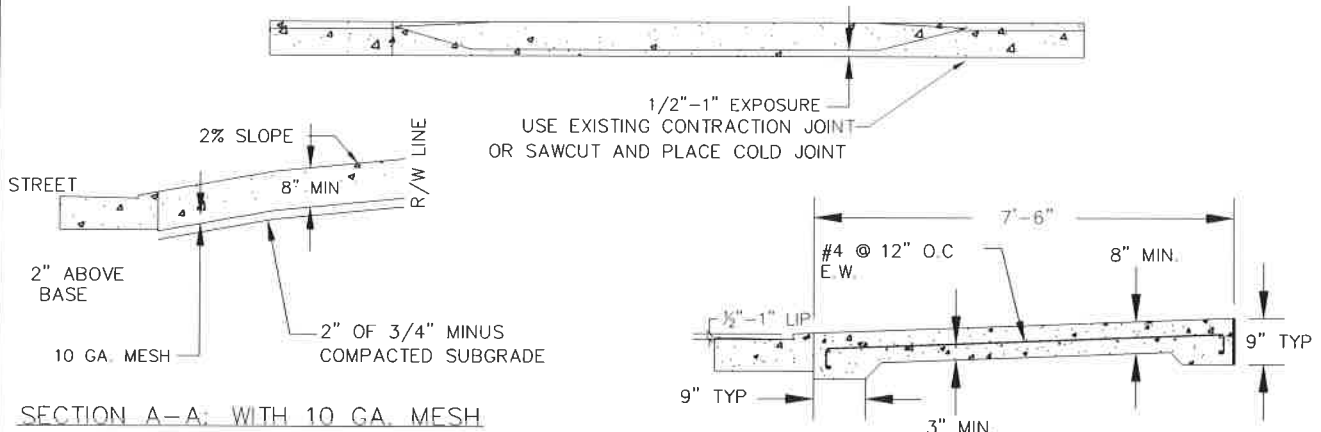

SECTION A-A: WITH 10 GA. MESH

SECTION A-A: WITH REBAR

NOTES:


- 1) CONCRETE TO HAVE 28 DAY COMPRESSIVE STRENGTH OF 3500 PSI
- 2) SCORE MARKS ARE TO BE TOOLED INTO CONCRETE SURFACE TO FORM A SQUARE BUT NOT TO EXCEED 8' IN ANY DIRECTION
- 3) REINFORCING BAR IS TO BE HELD UP WITH NON-CORROSIVE MATERIALS(ROCK, CONCRETE) PRIOR TO CONCRETE BEING PLACED
- 4) CONCRETE IS TO RECEIVE A MEDIUM BROOM FINISHED. BROOMING IS TO BE PERPENDICULAR TO THE CURB LINE
- 5) CURB JOINT SHALL BE A TROWELED JOINT WITH A MIN. 1/2" RADIUS ALONG BACK OF CURB.
- 6) DRIVEWAY SHALL BE A MINIMUM 8" THICK
- 7) FOR SIDEWALKS REFER TO STANDARD SIDEWALK DETAIL T-210
- 8) FOR CURB & GUTTER REFER TO STANDARD CURB & GUTTER DETAIL T-301




City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

COMMERCIAL DRIVEWAY
APPROACH DETAIL

DETAIL NO.
T-151
03/01/2021

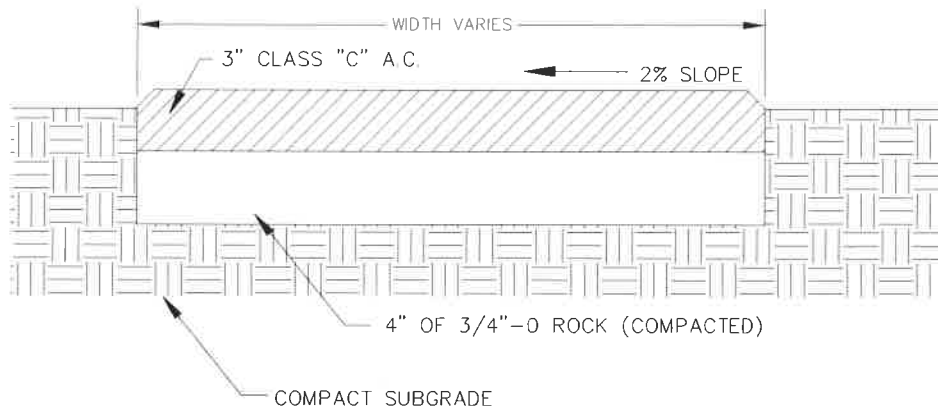

-OR-

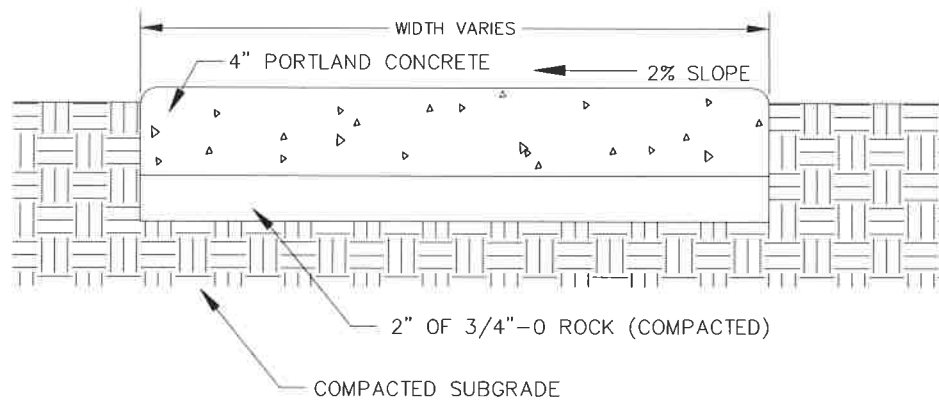

NOTES

1. CONCRETE TO HAVE 28 DAY COMPRESSIVE STRENGTH OF 3500 PSI
2. SIDEWALK PANELS SHALL BE SQUARE, 3/4" DEEP SCRIBES AT JOINTS, EDGED ON 4 SIDES AND HAVE A LIGHT BROOM FINISH.
3. PEDESTRIAN PATH OR BIKEWAY SHALL HAVE A MINIMUM WIDTH OF 5 FEET (ONE WAY)
A MINIMUM WIDTH OF 10 FEET (TWO WAY)



City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

PEDESTRIAN / BIKE PATH
DETAILS

DETAIL NO.


T-201

03/01/2021

NOTES:


- 1) CONCRETE SHALL BE 3500 PSI IN 28 DAYS
- 2) STANDARD SIDEWALK CROSS SLOPE SHALL BE 2%. WHEN THE LOT IS BELOW THE TOP OF THE CURB AND SLOPE DOWN FROM CURB, A MINUS 2% SLOPE MAY BE REQUIRED
- 3) CONCRETE DEPTH FOR SIDEWALKS SHALL BE A NOMINAL 4" MIN. DRIVEWAY SECTIONS INCLUDING SIDEWALKS THROUGH DRIVEWAYS SHALL BE NOMINAL 6" MIN FOR LOCAL STREETS AND 8" FOR ARTERIALS AND COLLECTORS
- 4) CONTRACTION JOINTS SHALL BE INSTALLED AT APPROXIMATE INTERVALS OF 15' BY CUTTING AT LEAST 1/3 OF THE DEPTH OF THE CONCRETE. "DUMMY" JOINTS SHALL BE INSTALLED AT APPROXIMATE INTERVALS OF 5'; EXPANSION JOINTS WITH PREMOLDED FILLER SHALL BE INSTALLED BETWEEN DRIVEWAYS & SIDEWALKS AT THE DIRECTION OF THE ENGINEER, SEE DRIVEWAY STANDARD
- 5) INSTALL A BOND BREAKER OR ISOLATION JOINT BETWEEN BACK OF CURB & SIDEWALK, & AROUND ANY OBSTRUCTION WITHIN SIDEWALK AREA
- 6) DRAIN BLOCKOUTS IN THE CURB SHALL BE EXTENDED TO THE BACK OF THE SIDEWALK WITH A 3" DIA. PLASTIC PIPE AT A 2% SLOPE. A CONTRACTION JOINT SHALL BE PLACED OVER THE PIPE
- 7) SEE STANDARD WHEELCHAIR/BICYCLE RAMP DETAILS FOR SIDEWALK PATTERNS AT INTERSECTION CURB RETURNS
- 8) SEE, ALSO, STANDARD DETAILS FOR DRIVEWAYS, T-150, T-151
- 9) A MIN. SEPARATION OF 4' BETWEEN CURB & SIDEWALK IS RECOMMENDED FOR LANDSCAPE MAINTENANCE
- 10) SIDEWALKS 8' AND WIDER SHALL HAVE A LONGITUDINAL CONTRACTION JOINT AT THE MIDPOINT

TOP OF CONCRETE SIDEWALK TO BE 1/4" ABOVE BACK OF CURB

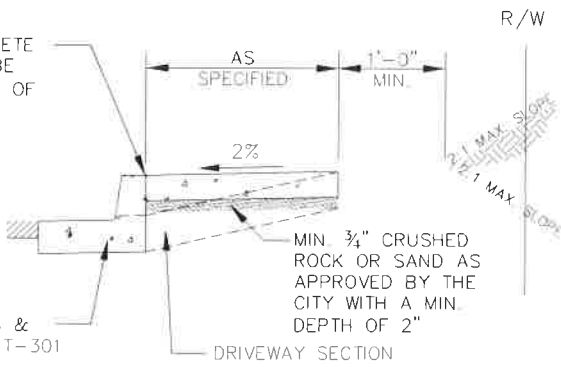


TYPICAL CURB TYPE CROSS SECTION

STANDARD CURB & GUTTER, DETAIL T-301

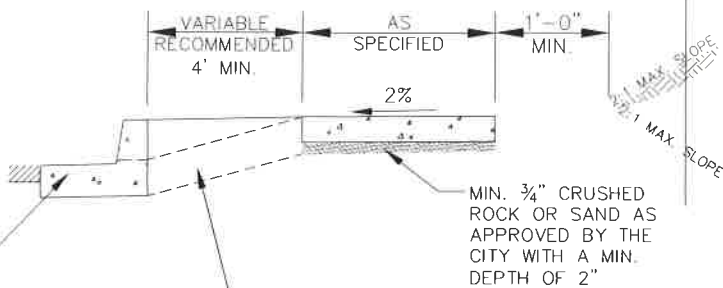


TYPICAL SETBACK TYPE CROSS SECTION

STANDARD CURB & GUTTER, DETAIL T-301

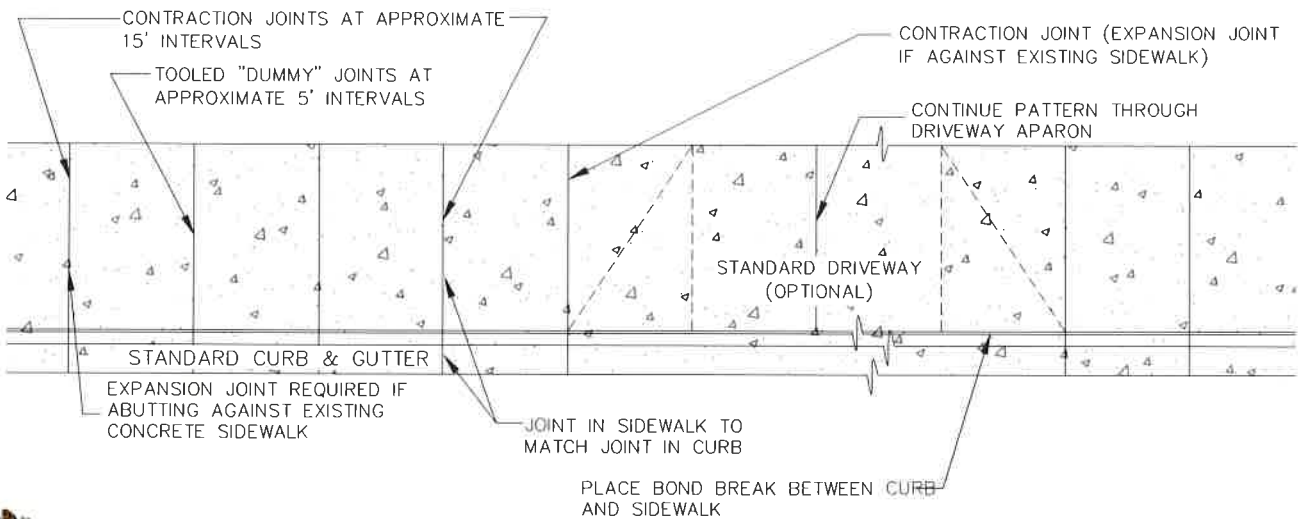

TYPICAL PLAN VIEW

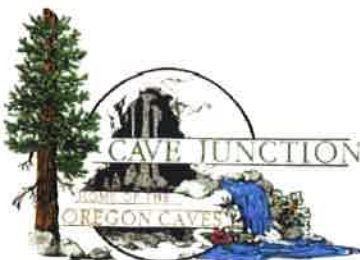


City of Cave Junction
 222 W. Lister Street
 Josephine, Oregon 97523
 (541) 592-2156

**STANDARD SIDEWALK
 DETAILS**


DETAIL NO.

T-210


03/01/2021

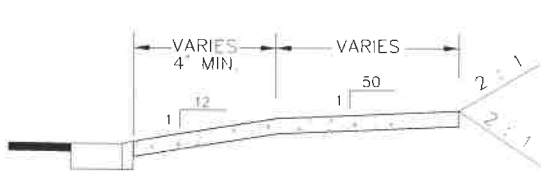

SECTION A-A

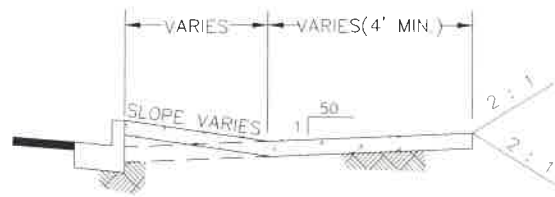

SECTION B-B

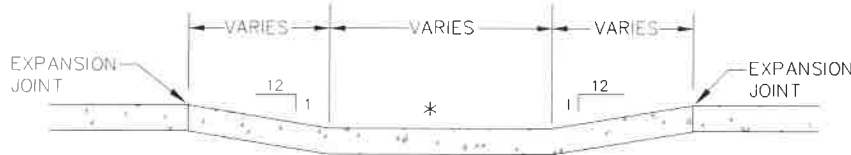


SECTION C-C

* SLOPE SIDEWALK TO PROVIDE POSITIVE DRAINAGE

NOTE:

1. WHEELCHAIR RAMP GRADES SHALL MEET ADA STANDARDS. THE TABLE PROVIDED BELOW IS TO ASSIST THE DESIGNER AND CONTRACTOR WHO ELECT TO CALCULATE ELEVATIONS TO MEET THOSE STANDARDS.
2. ADDITIONAL INFORMATION REGARDING SLOPE AND RAMP TEXTURING IS PROVIDED ON CITY STANDARD DRAWING NO. T-213.
3. CURB INLET OR CATCH BASIN SHALL NOT BE ALLOWED BETWEEN PTS. B & C OR PTS. F & G.
4. PROVIDE STOP LINE ONLY ON SIDE STREET APPROACHES TO MAIN STREETS WITH CENTERLINE STRIPING. CROSSWALK LINES WHERE REQUIRED MUST BE AS PER STRIPING PLAN APPROVED BY THE CITY ENGINEER.
5. CONCRETE SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 3500 PSI IN 28 DAYS

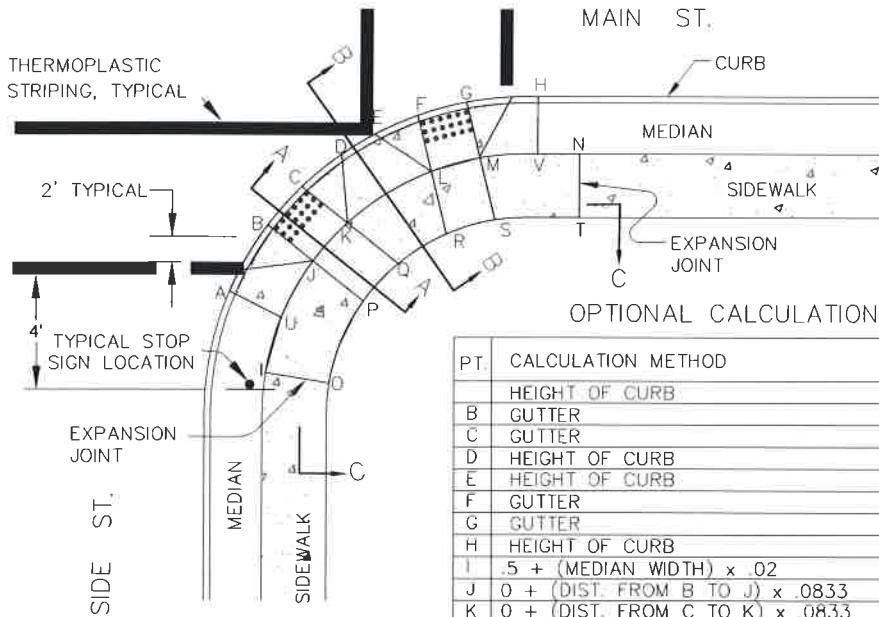

PLAN

OPTIONAL CALCULATION TABLE FOR POINT ELEVATIONS

PT.	CALCULATION METHOD	* + FROM GUTTER @ RIGHT ANGLE
	HEIGHT OF CURB	.5
B	GUTTER	0
C	GUTTER	0
D	HEIGHT OF CURB	.5
E	HEIGHT OF CURB	.5
F	GUTTER	0
G	GUTTER	0
H	HEIGHT OF CURB	.5
I	$.5 + (\text{MEDIAN WIDTH}) \times .02$	*
J	$0 + (\text{DIST. FROM B TO J}) \times .0833$	*
K	$0 + (\text{DIST. FROM C TO K}) \times .0833$	*
L	$0 + (\text{DIST. FROM F TO L}) \times .0833$	*
M	$0 + (\text{DIST. FROM G TO M}) \times .0833$	*
N	$.5 + (\text{MEDIAN WIDTH}) \times .02$	*
O	$.5 + (\text{MEDIAN WIDTH}) + (\text{DIST. FROM I TO O}) \times .02$	*
P	$0 + (\text{DIST. FROM B TO J}) \times .0833 + (\text{DIST. FROM J TO P}) \times .02$	*
Q	$0 + (\text{DIST. FROM C TO K}) \times .0833 + (\text{DIST. FROM K TO Q}) \times .02$	*
R	$0 + (\text{DIST. FROM F TO L}) \times .0833 + (\text{DIST. FROM L TO R}) \times .02$	*
S	$0 + (\text{DIST. FROM G TO M}) \times .0833 + (\text{DIST. FROM M TO S}) \times .02$	*
T	$.5 + (\text{MEDIAN WIDTH}) + (\text{DIST. FROM N TO T}) \times .02$	*
U	$J + (\text{DIST. FROM J TO U}) \times .0833$	*
V	$M + (\text{DIST. FROM M TO V}) \times .0833$	*


* DESIGNER MAY CALCULATE ELEVATIONS AT LOCATIONS SHOWN.



City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156


**SIDEWALK AND RAMP DETAIL
WITH PLANTER STRIP**

DETAIL NO.
T-211
03/01/2021

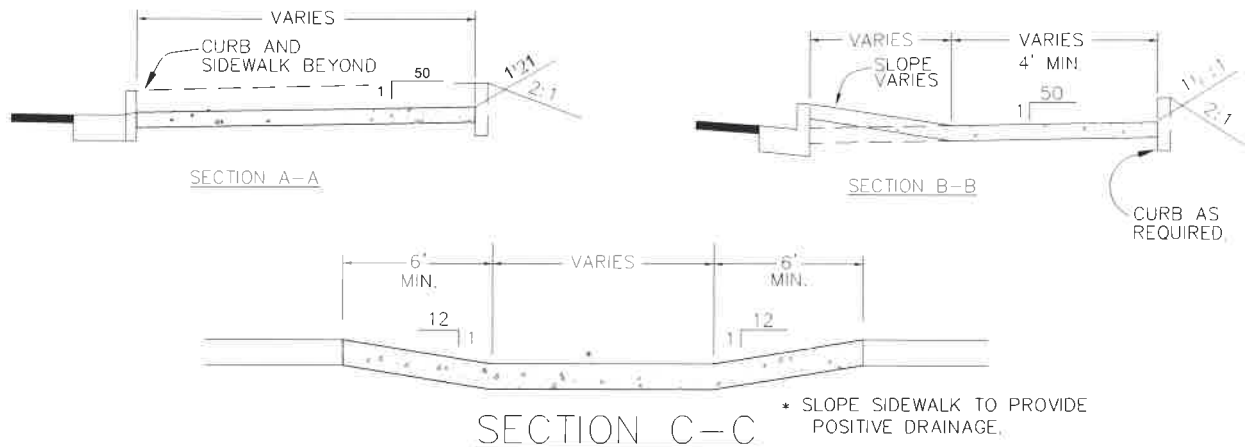

NOTE:

1. WHEELCHAIR RAMP GRADES SHALL MEET ADA STANDARDS. THE TABLE BELOW IS PROVIDED TO ASSIST THE DESIGNER AND CONTRACTOR WHO ELECT TO CALCULATE ELEVATIONS TO MEET THOSE STANDARDS.
2. ADDITIONAL INFORMATION REGARDING SLOPE AND RAMP TEXTURING IS PROVIDED ON CITY STANDARD DRAWING NO. T-214.
3. CURB INLET OR CATCH BASIN SHALL NOT BE ALLOWED BETWEEN PTS. B & C OR PTS. F & G.
4. PROVIDE STOP LINE ONLY ON SIDE STREET APPROACHES TO MAIN STREETS WITH CENTERLINE STRIPING. CROSSWALK LINES WHERE REQUIRED MUST BE AS PER STRIPING PLAN APPROVED BY THE CITY ENGINEER.
5. CONCRETE SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 3300 PSI IN 28 DAYS

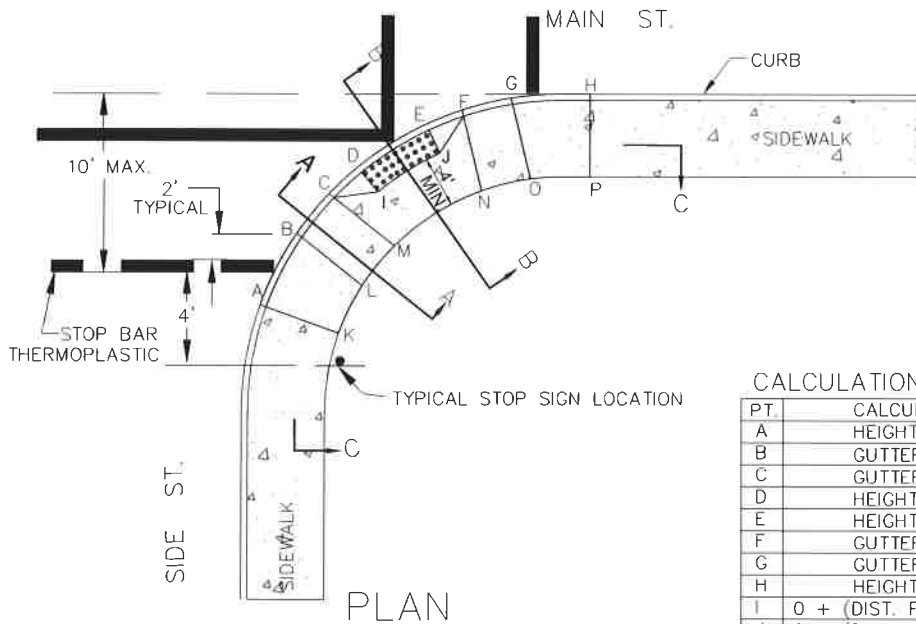

OPTIONAL
CALCULATION TABLE FOR POINT ELEVATIONS

PT.	CALCULATION METHOD	* + FROM GUTTER
A	HEIGHT OF CURB	.5
B	GUTTER	0
C	GUTTER	0
D	HEIGHT OF CURB	.5
E	HEIGHT OF CURB	.5
F	GUTTER	0
G	GUTTER	0
H	HEIGHT OF CURB	.5
I	$0 + (\text{DIST. FROM D TO I}) \times .02$	*
J	$0 + (\text{DIST. FROM E TO J}) \times .02$	*
K	$.5 + (\text{DIST. FROM A TO K}) \times .02$	*
L	$0 + (\text{DIST. FROM B TO L}) \times .02$	*
M	$0 + (\text{DIST. FROM C TO M}) \times .02$	*
N	$0 + (\text{DIST. FROM F TO N}) \times .02$	*
O	$0 + (\text{DIST. FROM G TO O}) \times .02$	*
P	$.5 + (\text{DIST. FROM H TO P}) \times .02$	*


* DESIGNER MAY CALCULATE ELEVATIONS AT LOCATIONS SHOWN.




City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

**SIDEWALK AND RAMP DETAIL
WITHOUT PLANTER STRIP**

DETAIL NO.
T-212
03/01/2021

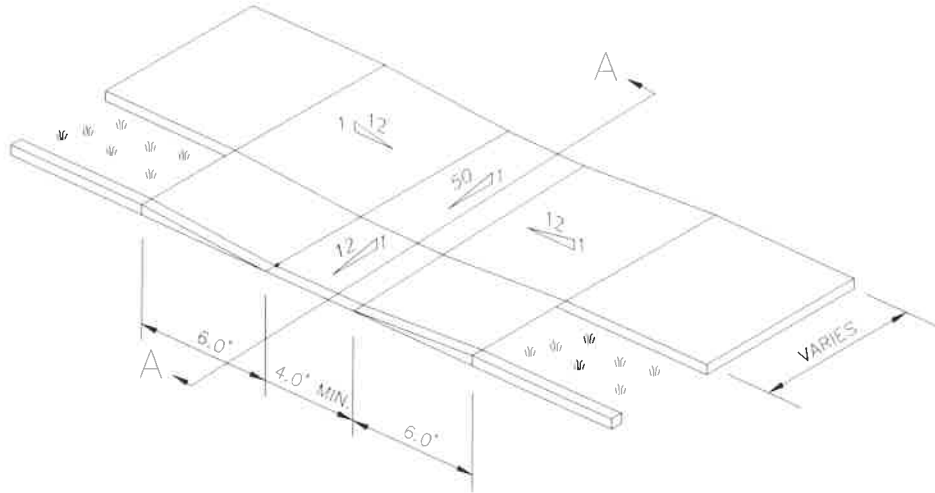


SIDEWALK RAMP DETAIL

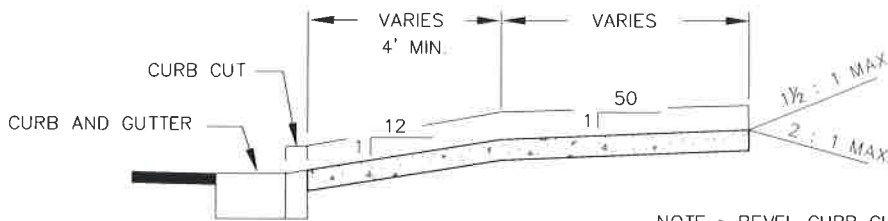


NOTE : BEVEL CURB CUT FROM GUTTER TO THE BACK OF CURB AT 8.33%

SECTION A-A



TRUNCATED DOME DETAIL

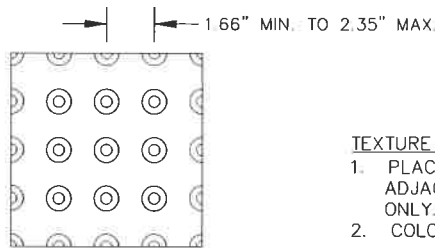

RAMP TEXTURE DETAIL

TEXTURE NOTES:

1. PLACE DOME TEXTURE IN THE LOWER 2' ADJACENT TO TRAFFIC THROAT OF RAMP ONLY.
2. COLOR OF DOMES TO BE SAFETY YELLOW.

RAMP TEXTURE DETAIL




City of Cave Junction
 222 W. Lister Street
 Josephine, Oregon 97523
 (541) 592-2156

**RAMP AND TEXTURE DETAIL
 WITH PLANTER STRIP**


DETAIL NO.

T-213

03/01/2021

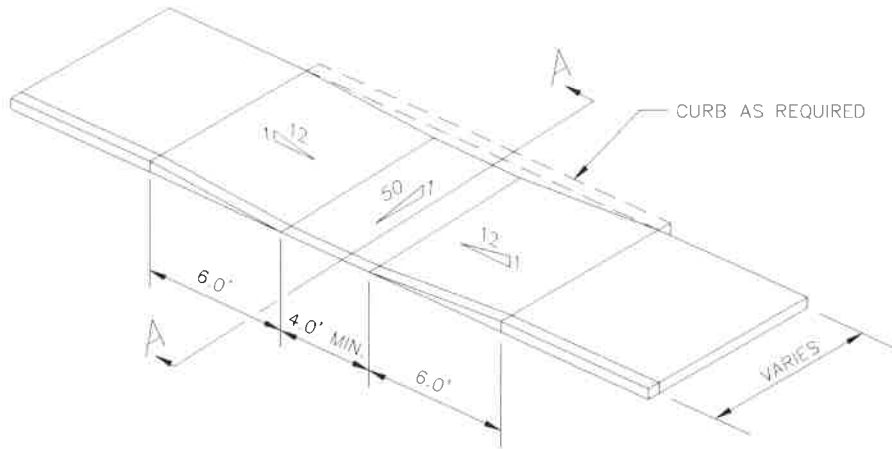


SIDEWALK RAMP DETAIL

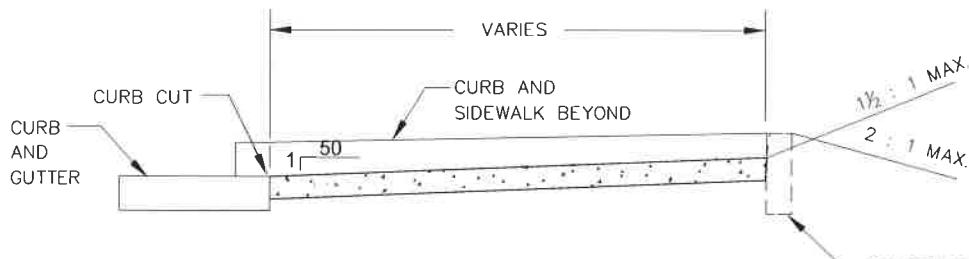


NOTE:
BEVEL CURB CUT FROM GUTTER
TO THE BACK OF CURB AT 2%

CONSTRUCT TYPE "C" CURB AT
NEW RAMPS WHERE ADJACENT
GROUND SLOPES AWAY
FROM SIDEWALK AS SHOWN.

SECTION A-A



TRUNCATED DOME DETAIL

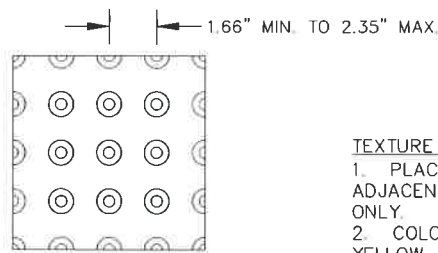


RAMP TEXTURE DETAIL

TEXTURE NOTES:

1. PLACE DOME TEXTURE IN THE LOWER 2' ADJACENT TO TRAFFIC THROAT OF RAMP ONLY.
2. COLOR OF DOMES TO BE SAFETY YELLOW.

RAMP TEXTURE DETAIL

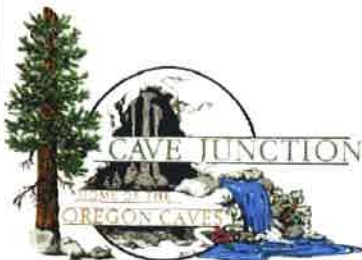


City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

**RAMP AND TEXTURE DETAIL
WITHOUT PLANTER STRIP**

DETAIL NO.

T-214


03/01/2021

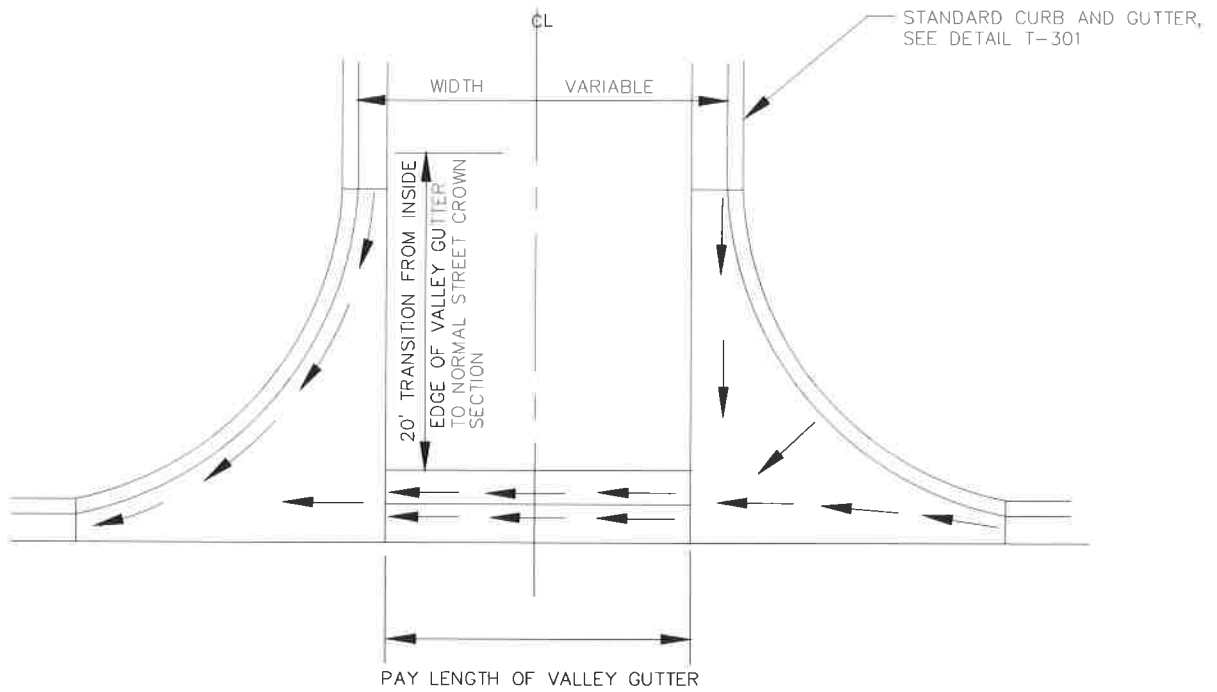

3 - #4 REBAR CONTINUOUS,
REBAR SHOULD BE CENTERED
IN VALLEY GUTTER

EXIST'G CONCRETE
OR AC ROADWAY,
TYP APPROXIMATE
DEPTH = 6"

UNDISTURBED SOIL, TYP

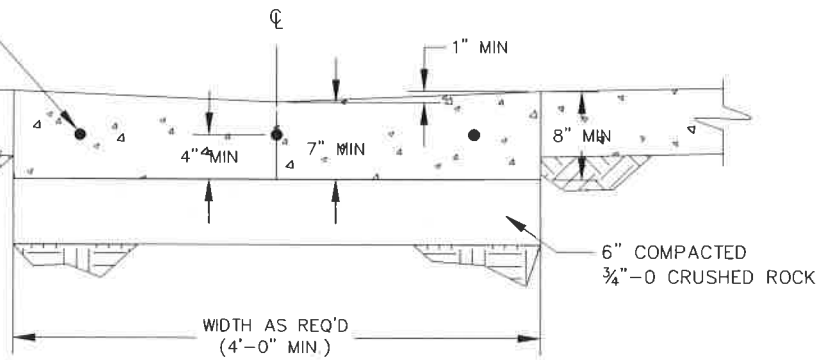

NOTE:

- 1) VALLEY GUTTERS ARE NOT TO BE USED EXCEPT FOR IN ALLEYS OR OTHER SPECIAL CONDITIONS AS APPROVED BY CITY ENGINEER.
- 2) CONCRETE VALLEY GUTTER SHALL BE ODOT CLASS 3500 CONCRETE




City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

VALLEY GUTTER DETAIL

DETAIL NO.

T-302

03/01/2021

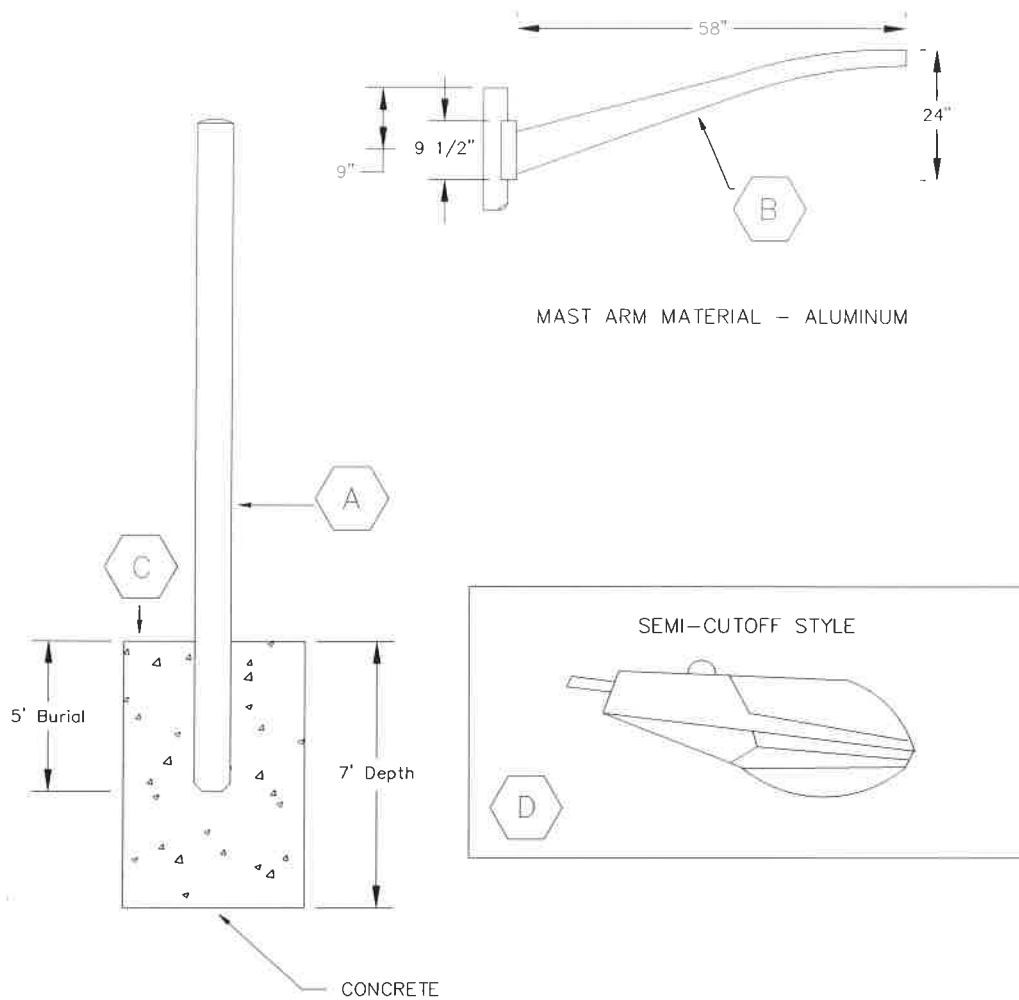

ITEM	DESCRIPTION
A	25' GRAY METAL POLE
B	5' ALUMINUM MAST ARM
C	CONCRETE
D	100 W HPS ROADWAY LAMP (WILL VARY DEPENDING ON LIGHTING REQUIREMENT)

NOTE:
MOUNTING OF POLE AND LIGHT TO COMPLY WITH LOCAL ELECTRICAL UTILITY REQUIREMENTS AND THE NEC.




City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

STANDARD STREET LIGHT DETAIL

DETAIL NO.

T-401

03/01/2021

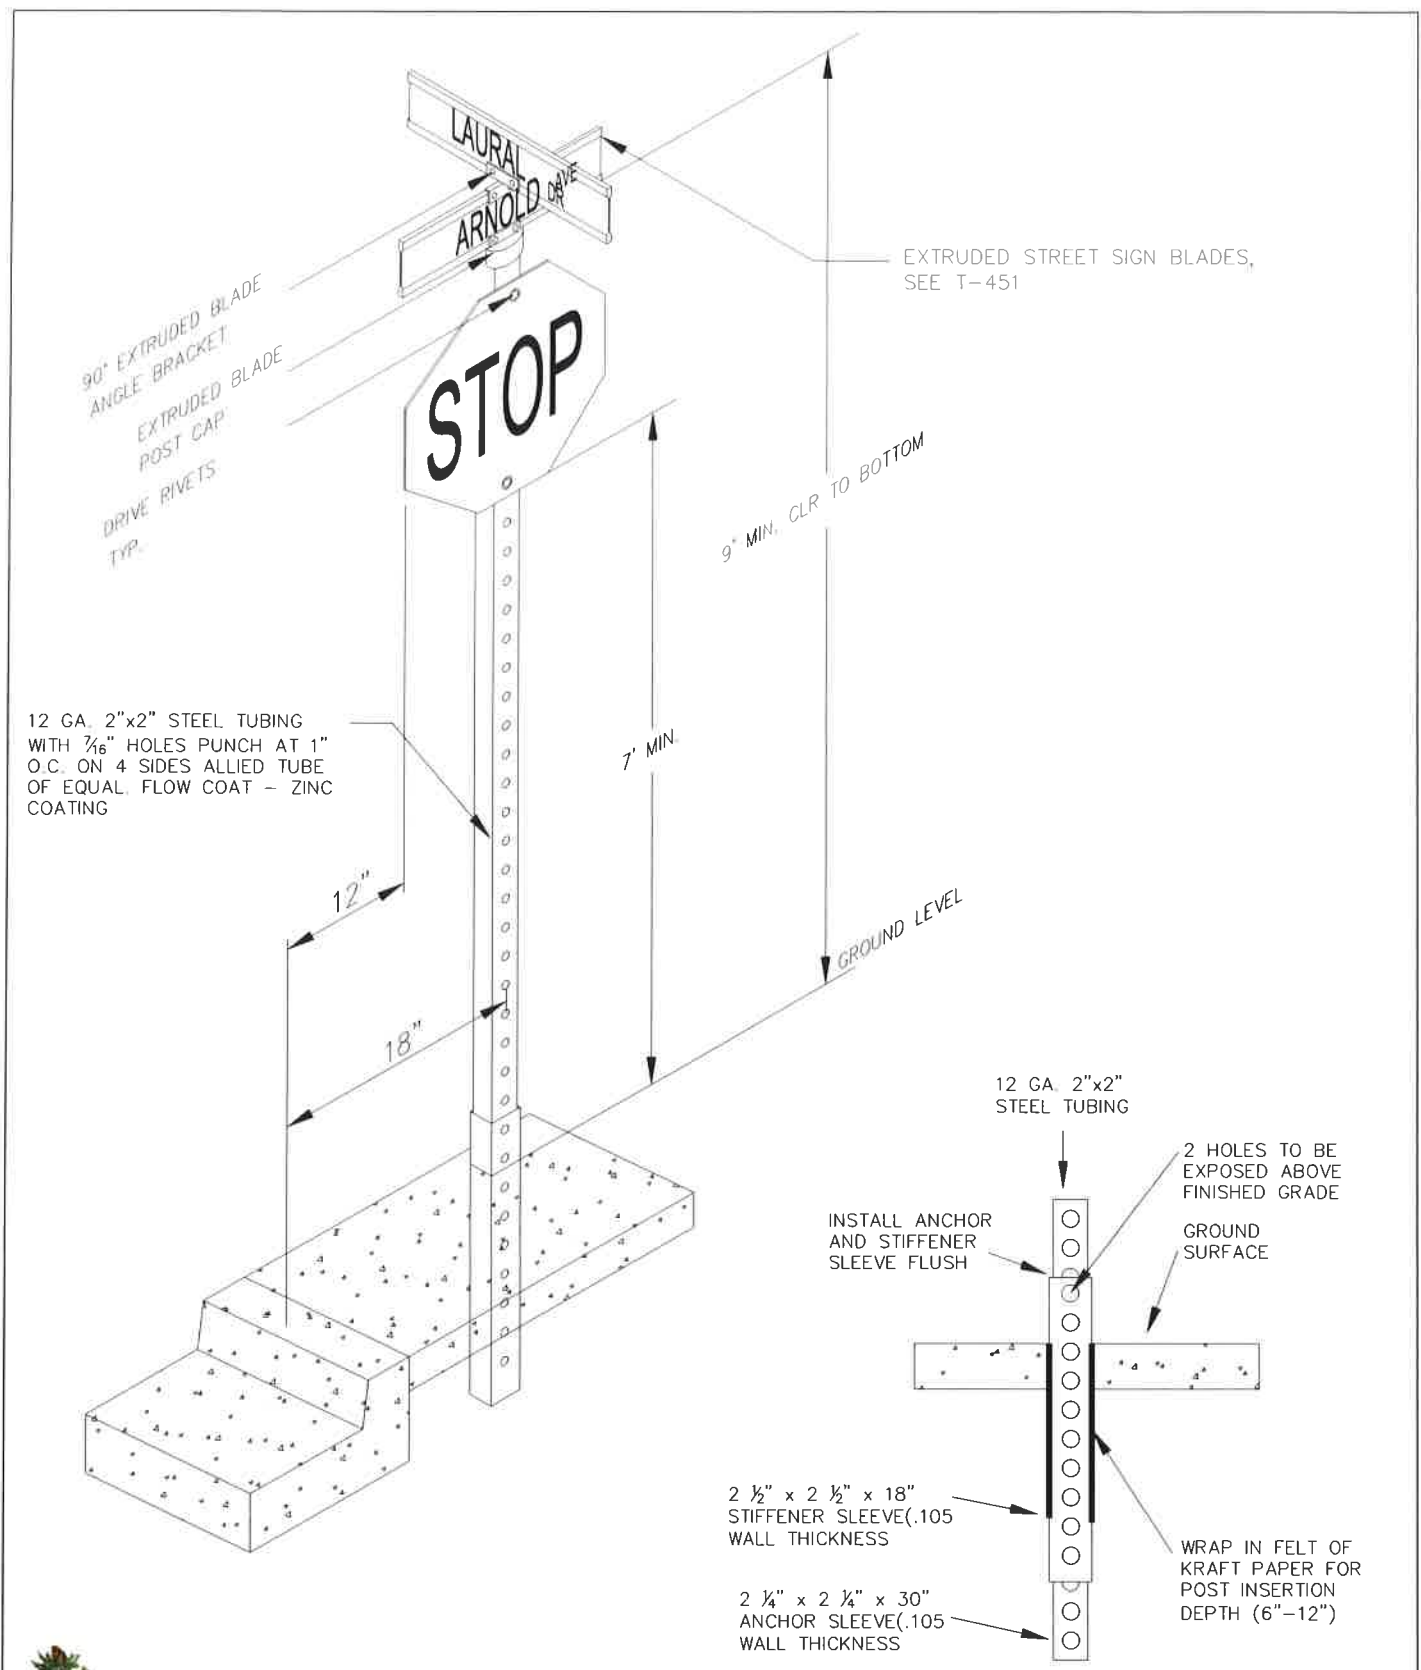


YIELDING BREAKAWAY ANCHOR
BASE ASSEMBLY



City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

STANDARD SIGN DETAIL

DETAIL NO.
T-450
03/01/2021

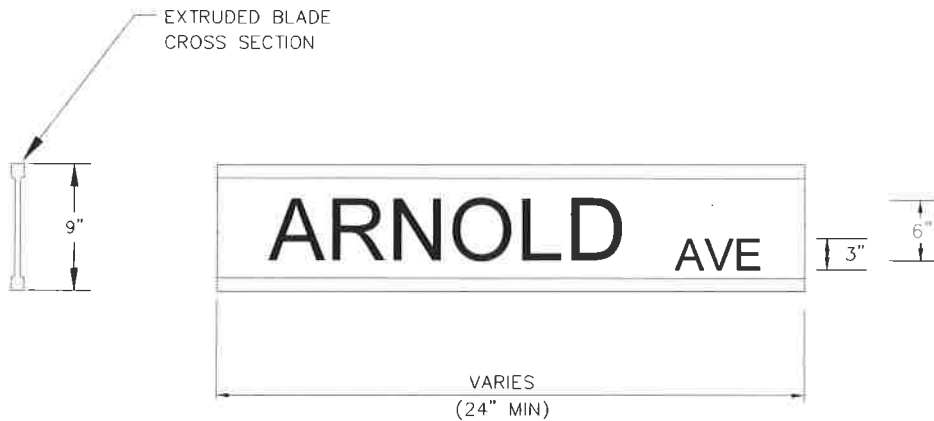

NOTES:

1. MATERIALS

STREET NAME SIGN SHALL BE 9" HEIGHT, EXTRUDED ALUMINUM. THE MINIMUM LENGTH SHALL BE 24" AND MAXIMUM LENGTH SHALL BE 36"
 BOTH SIDES OF STREET NAME SIGNS SHALL BE GREEN 3M SCOTCHLITE BRAND HIGH INTENSITY REFLECTIVE SHEETING WITH WHITE BORDER.

2. LETTERING

ALL LETTERS, NUMBERS, AND BORDERS USED TO FABRICATE A STREET NAME SIGN SHALL BE HIGH INTENSITY SILVER USING 3M SCOTCHLITE BRAND. THERE ARE TWO SIZES OF LETTERS THAT MAKE UP A STREET NAME SIGN. FOR PREFIXES, SUFFIXES, AND BLOCK NUMBERS A 3" SERIES 'C' IS USED. THE ACTUAL NAME OF THE STREET IS A 6" SERIES 'B'. ALL STREET NAME SIGNS SHALL HAVE BLOCK NUMBERS, AS ASSIGNED BY THE CITY, WHEN INSTALLED BY CONTRACTOR.

3. MISCELLANEOUS

STREET NAMES SHALL BE APPROVED BY THE PUBLIC WORKS DIRECTOR PRIOR TO THE SIGNS BEING FABRICATED AND INSTALLED.




City of Cave Junction
 222 W. Lister Street
 Josephine, Oregon 97523
 (541) 592-2156

**STREET SIGN AND
 LETTERING DETAILS**


DETAIL NO.

T-451

03/01/2021

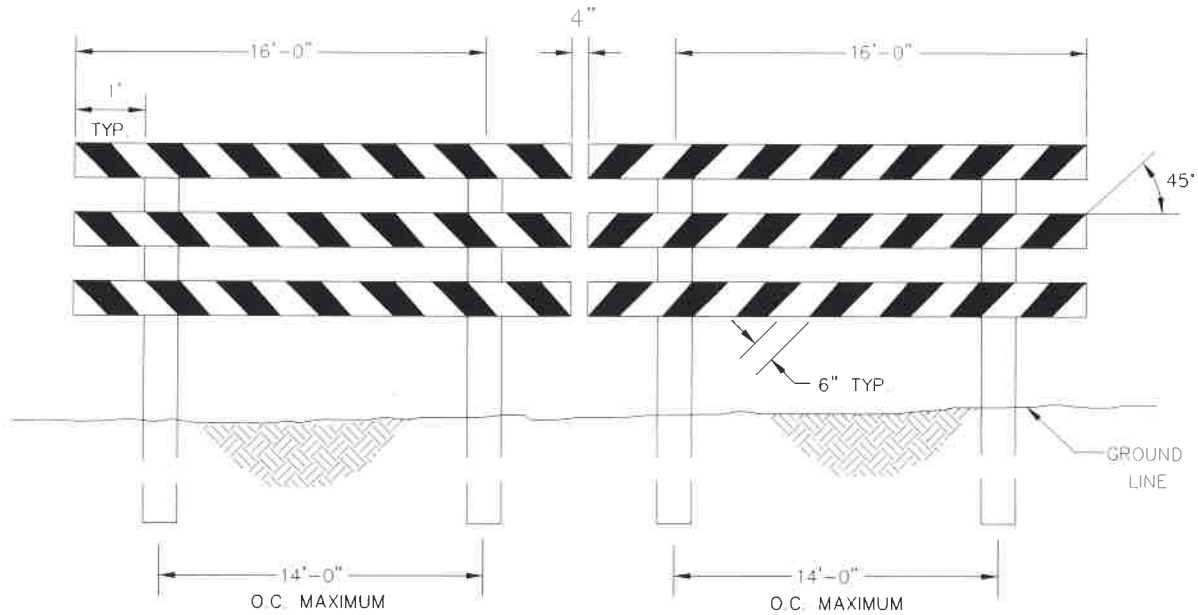

ELEVATION

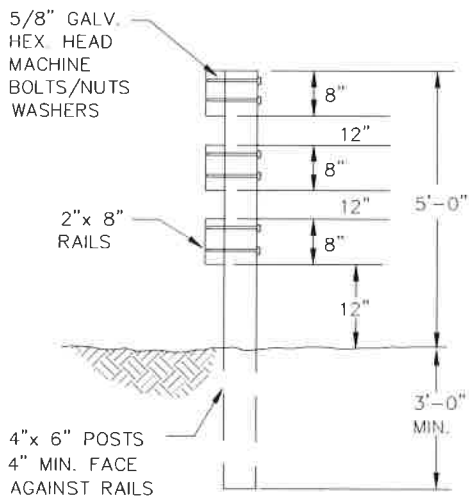


END VIEW

N.T.S.

NOTES:

1. RAILS TO BE RETROREFLECTIVE WHITE AND ORANGE STRIPES. POSTS TO BE PRESSURE TREATED.
2. SEE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES FOR STREETS AND HIGHWAYS AND THE OREGON SUPPLEMENT.
3F-1 BARRICADES
6C-8 BARRICADE DESIGN
6C-9 BARRICADE APPLICATION
3. ALL MATERIAL AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE CURRENT STATE OF OREGON STANDARD SPECIFICATIONS FOR HIGHWAY CONSTRUCTION.
4. FOR WIDER APPLICATIONS, MULTIPLE SECTIONS AS SHOWN SHALL BE USED.

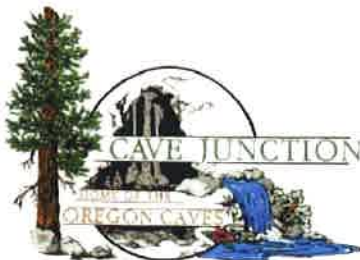

City of Cave Junction
222 W. Lister Street
Josephine, Oregon 97523
(541) 592-2156

**STANDARD PERMANENT
BARRICADE DETAIL**

DETAIL NO.

T-501